



Installation and Maintenance Manual

## **CTC EcoAir 400**

Model 406 / 408 / 410 / 415 / 420

Air/water heat pump



**Translation of the original instructions.**

**Keep for future use.**

**Read carefully before use.**

162 605 32-3 CR00983 2025-03-04



MADE IN SWEDEN

## Table of contents

|  |           |   |           |
|--|-----------|---|-----------|
| <b>1. Congratulations on buying your new product!.....</b> | <b>3</b>  | <b>9. Electrical installation .....</b>               | <b>24</b> |
| <b>2. Checklist.....</b>                                   | <b>4</b>  | 9.1 General information, electrical connections ..... | 24        |
| <b>3. Important to remember! .....</b>                     | <b>5</b>  | 9.2 Electric installation 400V 3N~ .....              | 24        |
| 3.1 Transportation .....                                   | 5         | 9.3 Electrical installation 230V 1N~ .....            | 24        |
| 3.2 Positioning.....                                       | 5         | 9.4 Alarm output.....                                 | 24        |
| 3.3 Recycling .....  | 5         | 9.5 Heat pump connections .....                       | 24        |
| 3.4 After commissioning .....                              | 5         | 9.6 Series connection of the CTC EcoAir 400 .....     | 25        |
| <b>4. Safety instructions .....</b>                        | <b>6</b>  | 9.7 Connecting the control system.....                | 27        |
| <b>5. Connection alternative CTC EcoAir 400 .....</b>      | <b>7</b>  | 9.8 Connecting the control system.....                | 32        |
| <b>6. Technical data.....</b>                              | <b>8</b>  | 9.9 Wiring diagram 400V 3N~ .....                     | 36        |
| 6.1 400V 3N~ EcoAir 406-408 .....                          | 8         | 9.10 Wiring diagram 230V 1N~ .....                    | 37        |
| 6.2 400V 3N~ EcoAir 410-420 .....                          | 9         | 9.11 Parts list.....                                  | 38        |
| 6.3 230V 1N~ EcoAir 406-410 .....                          | 10        | 9.12 Sensor Data .....                                | 39        |
| 6.4 Component location.....                                | 12        | <b>10. First start.....</b>                           | <b>41</b> |
| 6.5 Dimensions diagram .....                               | 14        | <b>11. Operation and Maintenance .....</b>            | <b>42</b> |
| 6.6 Refrigerant system.....                                | 15        | 11.1 Defrost.....                                     | 42        |
| <b>7. Installation.....</b>                                | <b>16</b> | 11.2 The fan.....                                     | 42        |
| 7.1 Location of the heat pump .....                        | 17        | 11.3 Maintenance .....                                | 42        |
| 7.2 Preparation and drainage .....                         | 18        | 11.4 Periodic maintenance .....                       | 42        |
| 7.3 Condensation water .....                               | 19        | 11.5 Operation stop .....                             | 42        |
| <b>8. Pipe installation .....</b>                          | <b>20</b> | 11.6 Condensation water tray .....                    | 42        |
| 8.1 Pipe connection.....                                   | 20        | <b>12. Troubleshooting.....</b>                       | <b>43</b> |
| 8.2 Example pipe connection.....                           | 21        |   |           |
| 8.3 Circulation pump.....                                  | 21        |   |           |
| 8.4 Pressure drop chart.....                               | 22        |   |           |
| 8.5 Control/supply .....                                   | 23        |   |           |
| 8.6 Operating range.....                                   | 23        |   |           |

## Software update



software.ctc.se

EN

For more information on updated functions and downloading the latest software, see the website "software.ctc.se".

## 1. Congratulations on buying your new product!



### The complete air source heat pump

The CTC EcoAir 400 is an outdoor air source heat pump which moves heat from the outside air and delivers it to the heating circuit of the building. The CTC EcoAir 400 works with outside air temperatures down to -22°C.

The heat pump can be connected to a CTC EcoZenith, CTC EcoVent i360F or to an existing boiler via the CTC EcoLogic control system.

The CTC EcoAir 400 has been designed to operate with high efficiency and low noise levels. The heat pump has integrated discharge defrosting which keeps the evaporator coil free from ice to maintain high efficiency.

Save this manual containing the installation and maintenance instructions. If properly maintained, you will be able to enjoy the use of your CTC EcoAir 400 for many years. This manual provides all the information you will need.

## 2. Checklist

### The checklist must always be completed by the installation engineer

- If a service is performed, you may be required to provide this document.
- Installation must always be done according to the installation and maintenance instructions.
- Installation must always be carried out in a professional manner.

**Following installation, the unit must be inspected and functional checks performed as indicated below:**

### Pipe installation

- ☐ Heat pump filled, positioned and adjusted in the correct manner according to the instructions.
- ☐ The heat pump is positioned so that it can be serviced.
- ☐ Capacity of the charge/radiator pump (depending on type of system) for the flow required.
- ☐ Make sure there is flow.
- ☐ Open radiator valves (depending on type of system) and other relevant valves.
- ☐ Tightness test.
- ☐ Bleed the system.
- ☐ Check proper operation of the requisite safety valves.
- ☐ Action taken to deal with condensation water.

### Electrical installation

- ☐ Operating power switch.
- ☐ Correct wiring.
- ☐ Requisite sensors fitted.
- ☐ Heat pump activated and started.
- ☐ Accessories.

### Customer information (adapted to the relevant installation)

- ☐ Start-up with customer/installer.
- ☐ Menus/controls for selected system.
- ☐ Installation and Maintenance Manual handed over to the customer.
- ☐ Check and filling, heating circuit.
- ☐ Information on fine adjustments.
- ☐ Alarm information.
- ☐ Functional test of safety valves fitted.
- ☐ Register your Installation Certificate at [ctc.se](http://ctc.se). ([ctc-heating.com](http://ctc-heating.com)).
- ☐ Information on fault reporting procedures.

---

Date/Customer

---

Date/Installer



## 3. Important to remember!

Check the following points in particular at the time of delivery and installation:

### 3.1 Transportation

- Transport the heat pump to the installation location before removing the packaging. Move the product using one of the following means:
  - Forklift
  - Lifting band around the pallet. NB: Can only be used with the packaging on.
- The heat pump must be transported and stored upright.

### 3.2 Positioning

- The heat pump must be transported and stored upright.
- Remove the packaging and check before installation that the product has not been damaged in transit. Report any transport damage to the carrier.
- Place the product on a solid foundation, preferably concrete. If the heat pump needs to be placed on a soft carpet, base plates must be placed under the adjustable feet.
- Remember to leave an access and service area of at least 1 metre in front of the heat pump.
- The heat pump must not be placed below floor level.
- Avoid placing the heat pump in rooms where the walls are of lightweight design, as people in the adjoining room may be disturbed by the compressor and vibrations.

**When contacting CTC, always mention the following:**

- Serial number
- Model/Size
- the fault message shown in the display
- Your telephone number

### 3.3 Recycling

- The packaging must be deposited at a recycling station or with the installation engineer for correct waste management.
- Obsolete products must be disposed of correctly and transported to a waste station or distributor/retailer offering this service. Disposal of the product as household waste is not permitted.
- It is very important that the product's refrigerant, compressor oil and electric/electronic components are disposed of correctly.

### 3.4 After commissioning


- The installation engineer advises the property owner on the design and servicing of the system.
- The installation engineer fills in a checklist and contact information – the customer and installation engineer sign the list, which the customer keeps.
- Register the product for warranty and insurance via the website:  
<https://www.ctc-heating.com/customer-service#warranty-registration>



Information in this type of box [i] is intended to help ensure that the product functions optimally.



Information in this type of box [!] is particularly important for correctly installing and using the product.

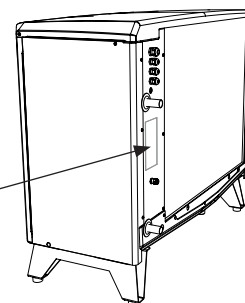

Fill in the information below. They may be useful to have if anything should happen.

|                       |                |
|-----------------------|----------------|
| Product:              | Serial number: |
| Installer:            | Name:          |
| Date:                 | Tel. no.:      |
| Electrical installer: | Name:          |
| Date:                 | Tel. no.:      |

No liability is accepted for any misprints. We reserve the right to make design changes.

## 4. Safety instructions



The installation should be preceded by an omnipolar safety switch according to overvoltage category III, which ensures disconnection from all electric power sources.

Turn off the power with an omnipolar switch before doing any work on the product.



The product must be connected to protective earth.



The product is classified as IP X4.



When handling the product with a hoist ring or similar device, make sure that the lifting equipment, eyebolts and other parts are not damaged. Never stand under the hoisted product.



Never jeopardise safety by removing bolted covers, hoods or similar.



Never jeopardise safety by deactivating safety equipment.



Any work on the product's cooling system should be carried out by authorised personnel only.



Service of the product's electrical system must only be carried out by a qualified electrician in compliance with the specific requirements of the national standard for electrical safety.

Replacement of damaged supply cable, must be carried out by the manufacturer or qualified service engineer to avoid risk.



This device can be used by children from the age of eight years and above and by people with reduced physical, sensory or mental ability or lack of experience or knowledge if they have been taught, either with supervision or with the instructions provided, how to use the device safely and understand the risks involved. Children should not play with the device. Cleaning and maintenance should not be carried out by children without supervision.



If these instructions are not followed when installing, operating and maintaining the system, CTC's commitment under the applicable warranty terms is not binding.

## 5. Connection alternative CTC EcoAir 400

The illustration below shows the different connection alternatives available for the CTC EcoAir 400. In some cases, a CTC Converter or CTC Basic display may be needed, see the chapter "Electrical installation/Connecting the control system".


The CTC EcoAir 400 can be connected to the products below:




CTC EcoLogic Pro/Family



CTC EcoLogic S, M, L




CTC EcoAir 400

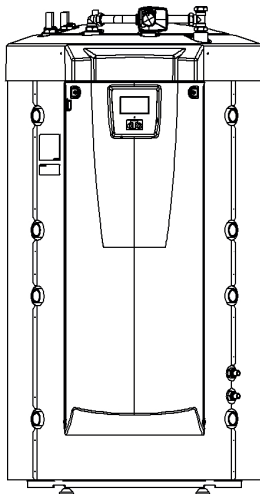

CTC EcoZenith i555 Pro

CTC EcoZenith i550 Pro

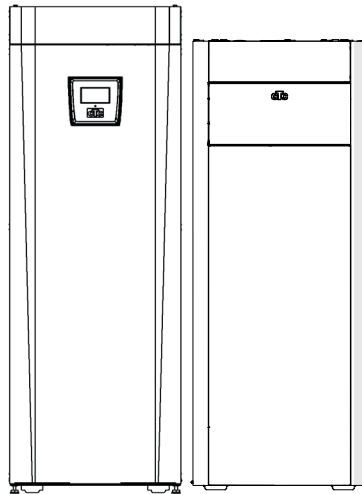


CTC EcoZenith i255

CTC EcoZenith i360

CTC EcoZenith i250

CTC EcoZenith i350

**!** Use the CTC Converter for docking with CTC EcoEl v3 and CTC EcoZenith v3.

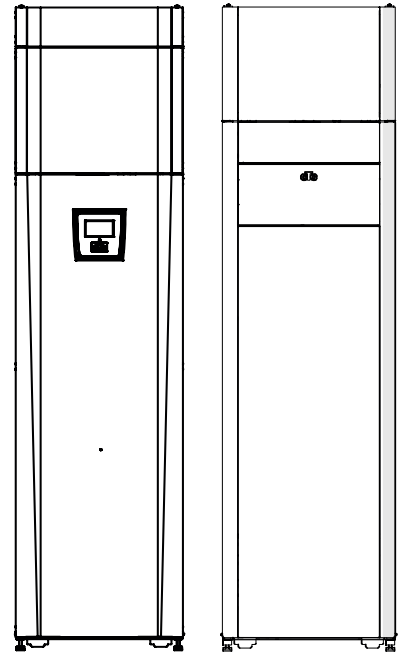

CTC EcoVent i360F

CTC EcoVent i350F

## 6. Technical data

### 6.1 400V 3N~ EcoAir 406-408

| General data   |                   | 406                                | 408                                |
|--|-------------------|------------------------------------|------------------------------------|
| Article number   |                   | 585600001                          | 585600002                          |
| HP-Keymark   |                   | 012-056                            | 012-057                            |
| Weight (gross) / Weight (net)  | kg                | 164 / 145                          | 169 / 150                          |
| Dimensions (DxWxH), package excluded                                   |                   | mm 545 x 1245 x 1080               |                                    |
| Heating capacity   |                   |                                    |                                    |
| Heating capacity max:<br>W35 & A +12/+7/+2/-7/-15                      | kW                | 7.24 / 6.22 / 4.69/<br>3.87 / 2.84 | 9.12 / 7.83 / 6.02/<br>4.73 / 3.63 |
| Power input max:<br>W35 & A +12/+7/+2/-7/-15                           | kW                | 1.33 / 1.30 / 1.28/<br>1.25 / 1.17 | 1.66 / 1.62 / 1.60/<br>1.57 / 1.50 |
| COP max:<br>W35 & A +12/+7/+2/-7/-15                                   | kW                | 5.44 / 4.78 / 3.66/<br>3.10 / 2.42 | 5.50 / 4.83 / 3.76/<br>3.02 / 2.42 |
| Sound data   |                   |                                    |                                    |
| Sound power L <sub>WA</sub> A7/W35 / A7/W55 (EN 12102)                 | dB(A)             | 56 / 56                            | 58 / 58                            |
| Sound pressure L <sub>PA</sub> 5m A7/W35                               | dB(A)             | 37                                 | 39                                 |
| Sound pressure L <sub>PA</sub> 10m A7/W35                              | dB(A)             | 31                                 | 33                                 |
| Electrical data  |                   |                                    |                                    |
| Rated electrical data  |                   | 400V 3N~ 50Hz                      |                                    |
| Rated power input  | kW                | 2.2                                | 2.7                                |
| Rated current  | A                 | 4.0                                | 4.9                                |
| Group fuse   | A                 | 10                                 |                                    |
| Ingress Protection class (IP)  |                   | IP X4                              |                                    |
| Maximum starting current <sup>1)</sup>                                 | A                 | 11.89                              | 10.84                              |
| Dimension power cable  | mm <sup>2</sup>   | 2.5                                |                                    |
| Warm side  |                   |                                    |                                    |
| Maximum operation pressure (PS)  | bar               | 3.0                                |                                    |
| Water volume (V)   | liter             | 1.9                                | 2.4                                |
| Safety valve   | bar               | 2.5                                |                                    |
| Maximum operating temperature (TS)                                     | °C                | 100                                |                                    |
| Maximum operating temperature, condenser                               | °C                | 65                                 |                                    |
| Water volume, condenser  | liter             | 1.88                               | 2.35                               |
| Flow qw nominal: A7/W35, Δt=5K   | l/s               | 0.21                               | 0.27                               |
| Flow qw minimum: A7/W35 at defrost                                     | l/s               | 0.21                               | 0.27                               |
| Air system   |                   |                                    |                                    |
| Max incoming air temperature   | °C                | 35                                 |                                    |
| Min incoming air temperature   | °C                | -22                                |                                    |
| Air flow: max  | m <sup>3</sup> /h | 2500                               | 2800                               |
| Pressure drop across evaporator at max airflow                         | Pa                | 7                                  | 11                                 |
| Refrigerant system   |                   |                                    |                                    |
| Refrigerant quantity<br>(R407C, fluorinated greenhouse gases GWP 1774) | kg                | 2.2                                |                                    |
| CO <sub>2</sub> - equivalent   | ton               | 3.902                              |                                    |
| Pressure limiter, high pressure  | bar               | 31±0,7                             |                                    |
| Low pressure sensor  | bar               | -1.0...18.8                        |                                    |
| Max operating pressure, high pressure side (PS)                        | bar               | 31                                 |                                    |
| Max operating pressure, low pressure side (PS)                         | bar               | 18.8                               |                                    |

| Seasonal coefficient of performance data |     |     |
|--|-----|-----|
| SCOP for cold climate W35 (EN14825)      | 3.4 |     |
| SCOP for average climate W35 (EN14825)   | 3.9 |     |
| SCOP for warm climate W35 (EN14825)      | 4.8 | 4.9 |

160304-021-2

<sup>1)</sup> Max starting current measured at 100 mΩ ground circuit impedance.

The products do not require an annual check for refrigerant leakage.

## 6.2 400V 3N~ EcoAir 410-420

| General data   |                   | 410                               | 415                                 | 420                                 |
|--|-------------------|-----------------------------------|-------------------------------------|-------------------------------------|
| Article number   |                   | 585600003                         | 585600004                           | 585600005                           |
| HP-Keymark   |                   | 012-058                           | 012-059                             | 012-060                             |
| Weight (gross) / Weight (net)                          | kg                | 210 / 190                         | 232 / 212                           | 234 / 214                           |
| Dimensions (DxWxH), package excluded                   | mm                | 645 x 1375 x 1180                 |                                     |                                     |
| Heating capacity                                       |                   |                                   |                                     |                                     |
| Heating capacity max:<br>W35 & A +12/+7/+2/-7/-15      | kW                | 13.60/ 11.51/ 8.91/<br>7.32/ 5.58 | 18.26/ 15.92/<br>12.08/ 10.03/ 7.77 | 20.78/ 17.55/<br>13.87/ 11.42/ 8.96 |
| Power input max:<br>W35 & A +12/+7/+2/-7/-15           | kW                | 2.44/ 2.46/ 2.39/<br>2.29/ 2.15   | 3.55/ 3.52/ 3.39/<br>3.30/ 3.10     | 4.14/ 4.06/ 3.92/<br>3.78/ 3.59     |
| COP max:<br>W35 & A +12/+7/+2/-7/-15                   | kW                | 5.57/ 4.68/ 3.72/<br>3.20/ 2.59   | 5.14/ 4.52/ 3.57/<br>3.03/ 2.50     | 5.02/ 4.33/ 3.54/<br>3.02/ 2.50     |
| Sound data   |                   |                                   |                                     |                                     |
| Sound power L <sub>WA</sub> A7/W35 / A7/W55 (EN 12102) | dB(A)             | 58 / 58                           | 64 / 64                             | 66 / 66                             |
| Sound pressure L <sub>PA</sub> 5m A7/W35               | dB(A)             | 39                                | 45                                  | 47                                  |
| Sound pressure L <sub>PA</sub> 10m A7/W35              | dB(A)             | 33                                | 39                                  | 41                                  |
| Electrical data  |                   |                                   |                                     |                                     |
| Rated electrical data                                  |                   | 400V 3N~ 50Hz                     |                                     |                                     |
| Rated power input                                      | kW                | 3.7                               | 5.3                                 | 6.1                                 |
| Rated current  | A                 | 7.5                               | 10.0                                | 11.8                                |
| Group fuse   | A                 | 10                                | 13                                  | 13                                  |
| Ingress Protection class (IP)                          |                   | IP X4                             |                                     |                                     |
| Maximum starting current <sup>1)</sup>                 | A                 | 14.33                             | 24.03                               | 24.41                               |
| Dimension power cable                                  | mm <sup>2</sup>   | 2.5                               |                                     |                                     |
| Warm side  |                   |                                   |                                     |                                     |
| Maximum operation pressure (PS)                        | bar               | 3.0                               |                                     |                                     |
| Water volume (V)                                       | liter             | 2.8                               | 3.9                                 | 4.5                                 |
| Safety valve   | bar               | 2.5                               |                                     |                                     |
| Maximum operating temperature (TS)                     | °C                | 100                               |                                     |                                     |
| Maximum operating temperature, condenser               | °C                | 65                                |                                     |                                     |
| Water volume, condenser                                | liter             | 2.82                              | 3.85                                | 4.51                                |
| Flow qw nominal: A7/W35, Δt=5K                         | l/s               | 0.39                              | 0.56                                | 0.64                                |
| Flow qw minimum: A7/W35 at defrost                     | l/s               | 0.39                              | 0.56                                | 0.64                                |
| Air system   |                   |                                   |                                     |                                     |
| Max incoming air temperature                           | °C                | 35                                |                                     |                                     |
| Min incoming air temperature                           | °C                | -22                               |                                     |                                     |
| Air flow: max  | m <sup>3</sup> /h | 4100                              | 5400                                | 6200                                |
| Pressure drop across evaporator at max airflow         | Pa                | 20                                | 34                                  | 44                                  |



| Refrigerant system   |     |             |       |       |
|--|-----|-------------|-------|-------|
| Refrigerant quantity<br>(R407C, fluorinated greenhouse gases GWP 1774) | kg  | 2.7         | 3.4   | 3.5   |
| CO <sub>2</sub> - equivalent   | ton | 4.790       | 6.032 | 6.209 |
| Pressure limiter, high pressure  | bar | 31±0,7      |       |       |
| Low pressure sensor  | bar | -1.0...18.8 |       |       |
| Max operating pressure, high pressure side (PS)                        | bar | 31          |       |       |
| Max operating pressure, low pressure side (PS)                         | bar | 18.8        |       |       |
| Seasonal coefficient of performance data                               |     |             |       |       |
| SCOP for cold climate W35 (EN14825)                                    |     | 3.5         | 3.3   | 3.3   |
| SCOP for average climate W35 (EN14825)                                 |     | 3.9         | 3.8   | 3.7   |
| SCOP for warm climate W35 (EN14825)                                    |     | 4.8         | 4.6   | 4.5   |

160304-109-2

<sup>1)</sup> Max starting current measured at 100 mΩ ground circuit impedance.

The products do not require an annual check for refrigerant leakage.

## 6.3 230V 1N~ EcoAir 406-410

| General data   |                 | 406                                | 408                                | 410                                   |
|--|-----------------|------------------------------------|------------------------------------|---------------------------------------|
| Article number   |                 | 585600011                          | 585600012                          | 585600013                             |
| HP-Keymark   |                 | 012-056                            | 012-057                            | 012-058                               |
| Weight (gross) / Weight (net)                          | kg              | 164 / 145                          | 169 / 150                          | 210 / 190                             |
| Dimensions (DxWxH), package excluded                   | mm              | 545x1245x1080                      | 545x1245x1080                      | 645x1375x1180                         |
| Heating capacity                                       |                 |                                    |                                    |                                       |
| Heating capacity max:<br>W35 & A +12/+7/+2/-7/-15      | kW              | 7.24 / 6.22 / 4.69/<br>3.87 / 2.84 | 9.12 / 7.83 / 6.02/<br>4.73 / 3.63 | 13.60 / 11.51 /<br>8.91 / 7.32 / 5.58 |
| Power input max:<br>W35 & A +12/+7/+2/-7/-15           | kW              | 1.33 / 1.30 / 1.28/<br>1.25 / 1.17 | 1.66 / 1.62 / 1.60/<br>1.57 / 1.50 | 2.44 / 2.46 / 2.39/<br>2.29 / 2.15    |
| COP max:<br>W35 & A +12/+7/+2/-7/-15                   | kW              | 5.44 / 4.78 / 3.66/<br>3.10 / 2.42 | 5.50 / 4.78 / 3.66/<br>3.10 / 2.42 | 5.57 / 4.68 / 3.72/<br>3.20 / 2.59    |
| Sound data   |                 |                                    |                                    |                                       |
| Sound power L <sub>WA</sub> A7/W35 / A7/W55 (EN 12102) | dB(A)           | 56 / 56                            | 58 / 58                            | 58 / 58                               |
| Sound pressure L <sub>PA</sub> 5m A7/W35               | dB(A)           | 37                                 | 39                                 | 39                                    |
| Sound pressure L <sub>PA</sub> 10m A7/W35              | dB(A)           | 31                                 | 33                                 | 33                                    |
| Electrical data  |                 |                                    |                                    |                                       |
| Rated electrical data                                  |                 | 230V 1N~ 50Hz                      |                                    |                                       |
| Rated power input                                      | kW              | 2.2                                | 2.7                                | 3.8                                   |
| Rated current  | A               | 10.3                               | 12.4                               | 18.8                                  |
| Group fuse   | A               | 13                                 | 13                                 | 20                                    |
| Max. permitted impedance at connection*                | Ω               | -                                  | -                                  | 0.392                                 |
| Ingress protection class (IP)                          |                 | IP X4                              |                                    |                                       |
| Maximum starting current <sup>1)</sup>                 | A               | 22.8                               | 23.2                               | 23.5                                  |
| Dimension power cable                                  | mm <sup>2</sup> | 4.0                                |                                    |                                       |

| Warm side  |       |             |       |       |
|--|-------|-------------|-------|-------|
| Maximum operation pressure (PS)  | bar   | 3.0         |       |       |
| Water volume (V)   | liter | 1.9         | 2.4   | 2.8   |
| Safety valve   | bar   | 2.5         |       |       |
| Maximum operating temperature (TS)                                     | °C    | 100         |       |       |
| Maximum operating temperature, condenser                               | °C    | 65          |       |       |
| Water volume, condenser  | liter | 1.88        | 2.35  | 2.82  |
| Flow qw nominal: A7/W35, Δt=5K   | l/s   | 0.21        | 0.27  | 0.39  |
| Flow qw minimum: A7/W35 at defrost                                     | l/s   | 0.21        | 0.27  | 0.39  |
| Air system   |       |             |       |       |
| Max incoming air temperature   | °C    | 35          |       |       |
| Min incoming air temperature   | °C    | -22         |       |       |
| Air flow: max  | m³/h  | 2500        | 2800  | 4100  |
| Pressure drop across evaporator at max airflow                         | Pa    | 7           | 11    | 20    |
| Refrigerant system   |       |             |       |       |
| Refrigerant quantity<br>(R407C, fluorinated greenhouse gases GWP 1774) | kg    | 2.2         | 2.2   | 2.7   |
| CO <sub>2</sub> - equivalent   | ton   | 3.902       | 3.902 | 4.790 |
| Pressure limiter, high pressure  | bar   | 31±0,7      |       |       |
| Low pressure sensor  | bar   | -1.0...18.8 |       |       |
| Max operating pressure, high pressure side (PS)                        | bar   | 31          |       |       |
| Max operating pressure, low pressure side (PS)                         | bar   | 18.8        |       |       |
| Seasonal coefficient of performance data                               |       |             |       |       |
| SCOP for cold climate W35 (EN14825)                                    |       | 3.4         | 3.4   | 3.5   |
| SCOP for average climate W35 (EN14825)                                 |       | 3.9         | 3.9   | 3.9   |
| SCOP for warm climate W35 (EN14825)                                    |       | 4.8         | 4.9   | 4.8   |

160303-352-2

<sup>1)</sup> Max starting current measured at 100 mΩ ground circuit impedance.


\*Max permitted impedance at the mains connection according to EN 61000-3-12. If the impedance at the mains connection is higher than the specified, check with the grid owner before purchasing the equipment.


The products do not require an annual check for refrigerant leakage.



**Note:** In case of deviations, the product's data plate applies. When servicing always check the product's data plate for correct refrigerant quantity.


## 6.4 Component location

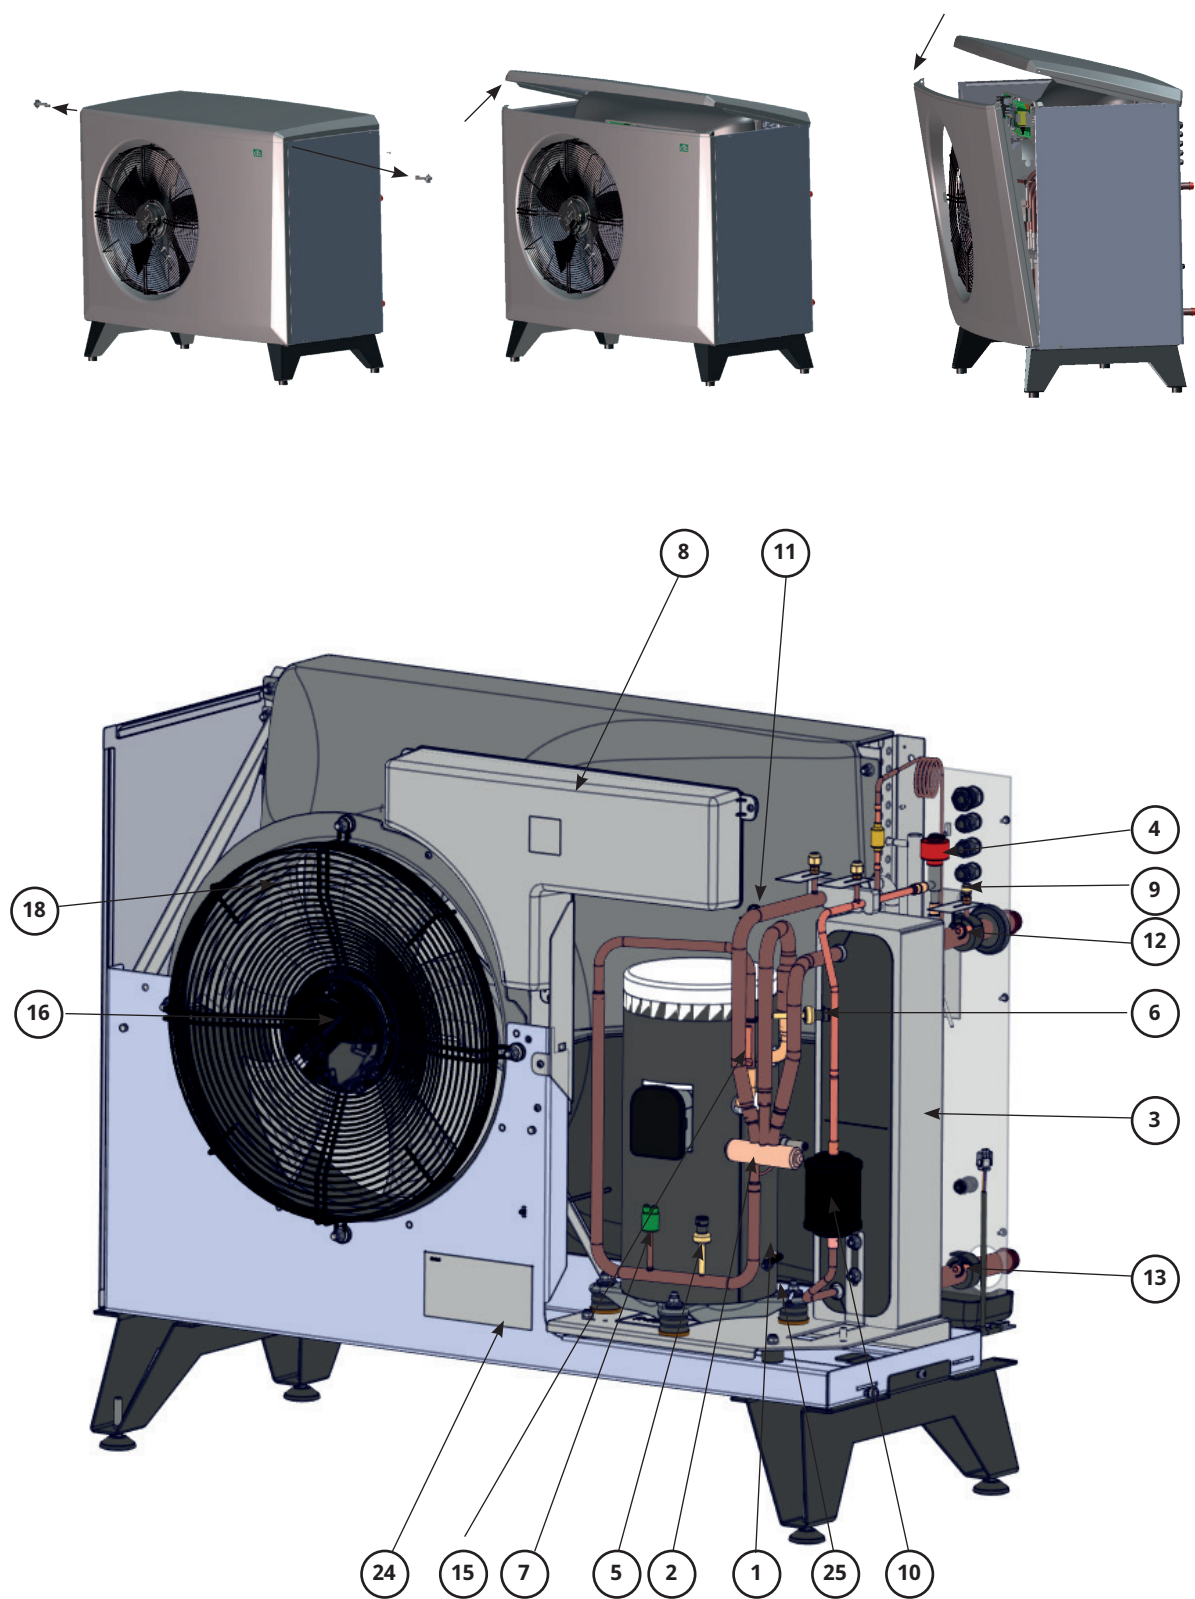

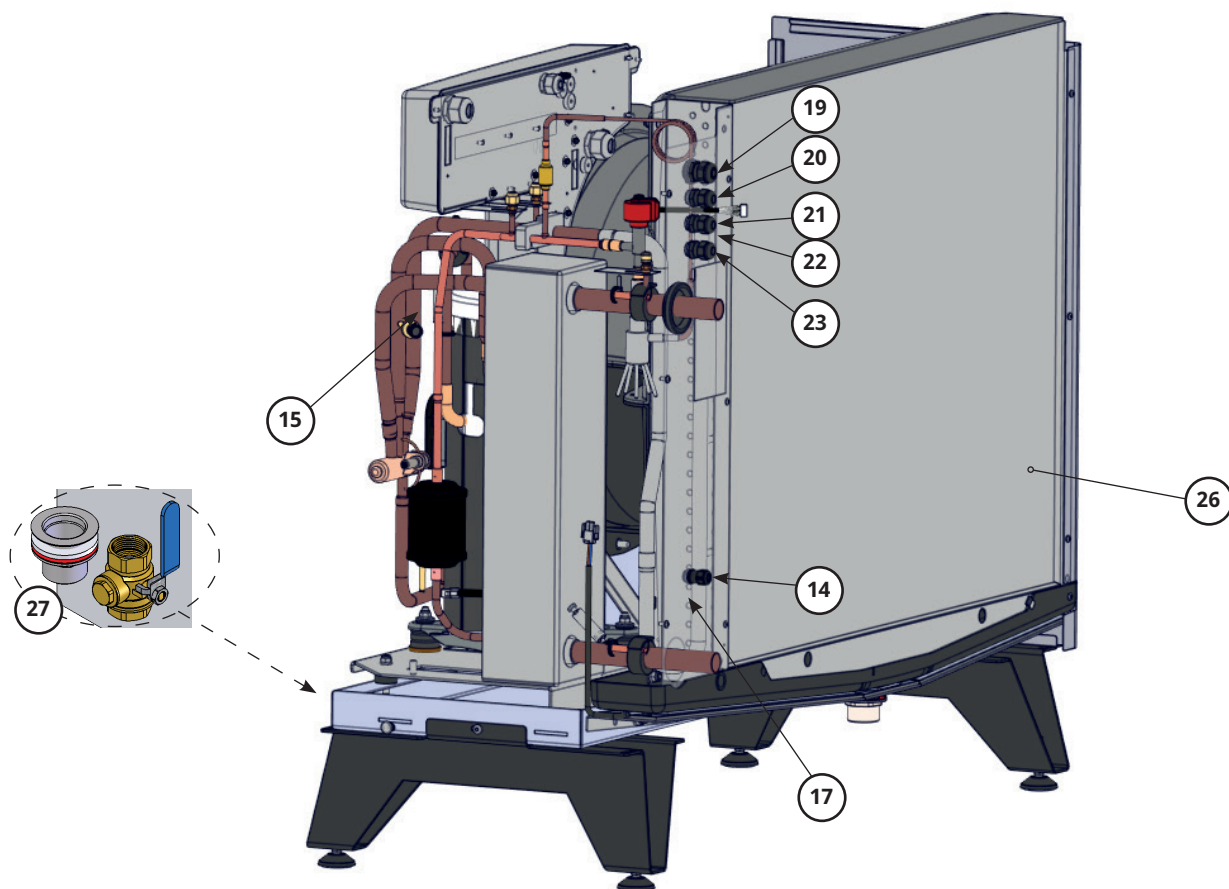

- |                          |   |
|--------------------------|---|
| 1. Compressor            | 16. Fan   |
| 2. 4-way valve           | 17. Defrosting sensor in evaporator   |
| 3. Condenser             | 18. Fan sensor  |
| 4. Expansion valve       | 19. Feeding product   |
| 5. High pressure sensor  | 20. Communication product   |
| 6. Low pressure sensor   | 21. Communication series connection   |
| 7. High pressure switch  | 22. Feeding pump  |
| 8. Connection box        | 23. Communication circulation pump  |
| 9. Bleeding nipple/water | 24. Type plate with serial number etc.  |
| 10. Drying filter        | 25. Compressor heater   |
| 11. Suction gas sensor   | 26. Evaporator  |
| 12. Primary flow sensor  | 27. Packaged components (filter ball valve and condensate drain) in box under product on pallet |
| 13. Return sensor        |   |
| 14. Outdoor sensor       |   |
| 15. Discharge sensor     |   |


## 6.5 Dimensions diagram

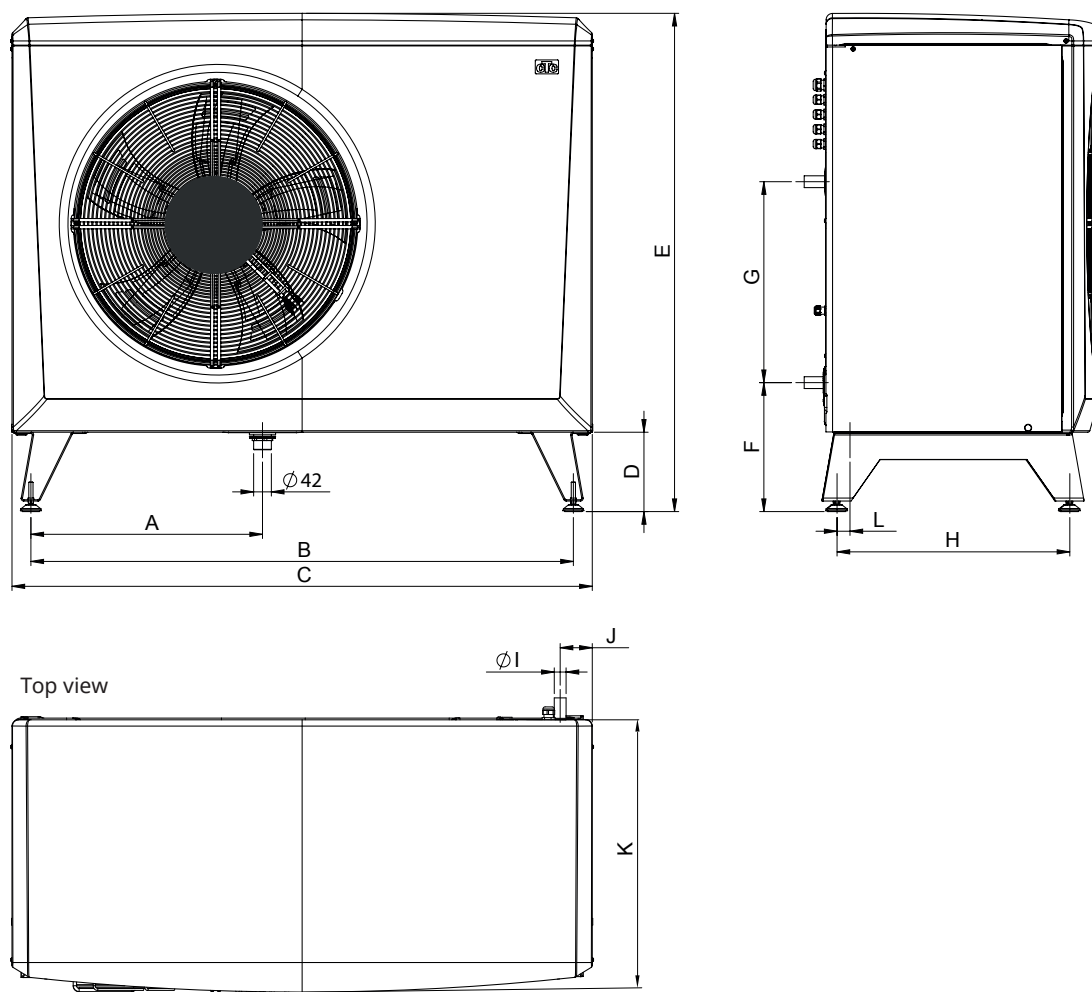

|   | CTC EcoAir 406, 408 | CTC EcoAir 410-420 |
|---|---------------------|--------------------|
| A | 486                 | 550                |
| B | 1155                | 1285               |
| C | 1245                | 1375               |
| D | 188                 | 188                |
| E | 1080                | 1180               |
| F | 308                 | 308                |
| G | 476                 | 476                |
| H | 451                 | 551                |
| I | $\varnothing 28$    | $\varnothing 28$   |
| J | 85                  | 83                 |
| K | 545                 | 645                |
| L | 10                  | 33                 |



## 6.6 Refrigerant system

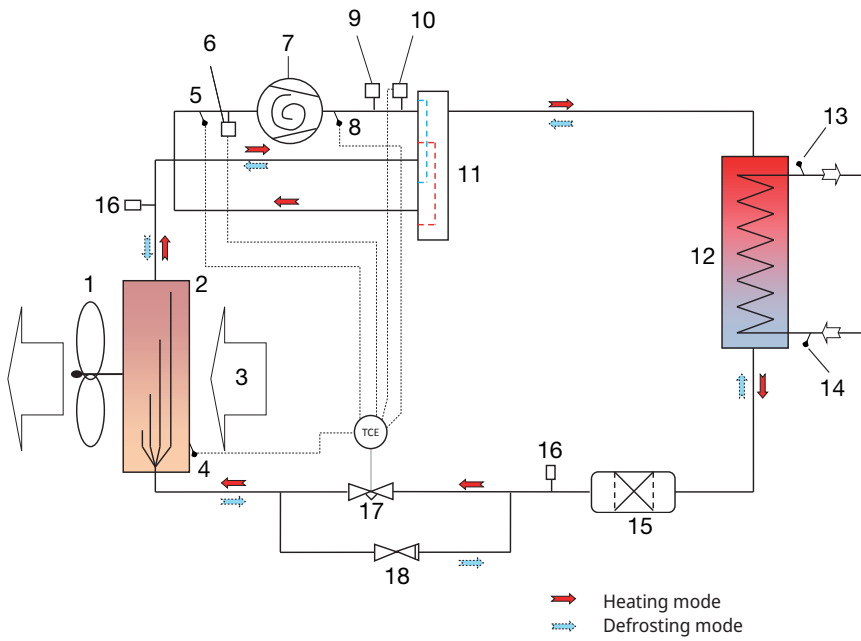

1. Fan
2. Evaporator
3. Air
4. Defrosting sensor (B16)
5. Suction gas sensor (B22)
6. Low pressure sensor (B101)
7. Compressor
8. Hot gas sensor (B21)
9. High pressure switch
10. High pressure sensor (B100)
11. 4-way valve
12. Condenser
13. Primary flow sensor (B1).
14. Return sensor (B7)
15. Drying filter
16. Schrader
17. Expansion valve
18. Non return valve

## 7. Installation

This section is aimed at anyone responsible for one or more of the installations required to ensure that the product works the way the property owner wants.

Take your time going through functions and settings with the property owner and answer any questions. Both you and the heat pump benefit from a user who has completely understood how the system operates and should be maintained.

The installation must be carried out in accordance with current MCS standards. Refer to MIS 3005 and associated building regs Part L,F & G. The product must be connected to an expansion vessel in an open or closed system. **Do not forget to flush the heating circuit clean before connection.**

The heat pump operates with a primary flow/return temperature across the condenser of up to 65/58°C.

### Transportation

Transport the unit to the installation site before removing the packaging. Handle the product in the following manner:

- Forklift
  - Lifting band around the pallet.
- NB:** Can only be used with the packaging on.


### Unpacking

Unpack the heat pump when it is placed next to its installation site. Check that the product has not been damaged in transit. Report any transport damage to the carrier. Also check that the delivery is complete according to the list below.

### Delivery includes:

- 1 x Heat pump CTC EcoAir 400
- Packaged component (see chapter titled 'Component Location')
  - filter ball valve: G1" (EcoAir 406-410), G1¼" (EcoAir 415-420)
  - condensate drain: G1¼"
- 15 m cable LiYCY (TP 2x2x0,75 mm<sup>2</sup>) with connector for communication, fitted
- 2 m power cable, fitted:

|                |        |                          |
|----------------|--------|--------------------------|
| EcoAir 406-410 | 3x400V | 5G x 2,5 mm <sup>2</sup> |
| EcoAir 415-420 | 3x400V | 5G x 2,5 mm <sup>2</sup> |
| EcoAir 406-410 | 1x230V | 3G x 4 mm <sup>2</sup>   |

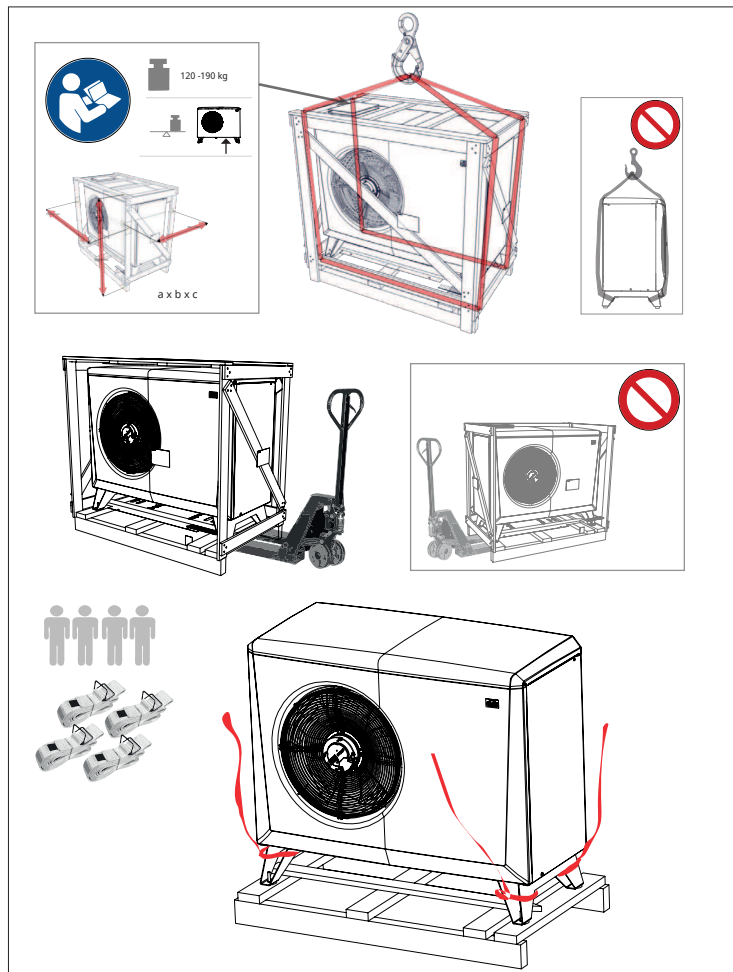


**!** The product must be transported and stored in an upright position.

## 7.1 Location of the heat pump

- CTC EcoAir 400 is normally placed against an outside wall.
- The distance between wall and product is recommended to be at least 250 mm (EcoAir 610M / 614M) and 400 mm (EcoAir 622M) respectively, so that the outdoor air can flow through the evaporator without hindrance.
- Allow a space of at least 2 metres between the heat pump and any bushes etc.
- Place the heat pump so that noise from the compressor and fan does not disturb the surroundings.
- Do not place the heat pump right next to a bedroom window, patio or fence. Consider the distance to the nearest neighbour.
- The recommended distance between units is 400 mm.
- The stand must stand stably on concrete blocks or similar.
- Use a spirit level to adjust the unit, so that it is completely level.
- Due to the design of the stand and the weight of the pump, it is not necessary to mount the unit to the ground or the wall.
- Installing the heat pump in a sheltered spot is inadvisable, and so is placing it in an outhouse or car port. because the air should flow as freely as possible through the heat pump and used air should not to be sucked into the inlet on the back. This can cause abnormal ice formation in the evaporator.
- If the product is located where it will be subjected to particularly harsh weather conditions, the product can be installed underneath a small awning.



These guidelines must be followed in order for your CTC EcoAir 400 to give the optimal performance.

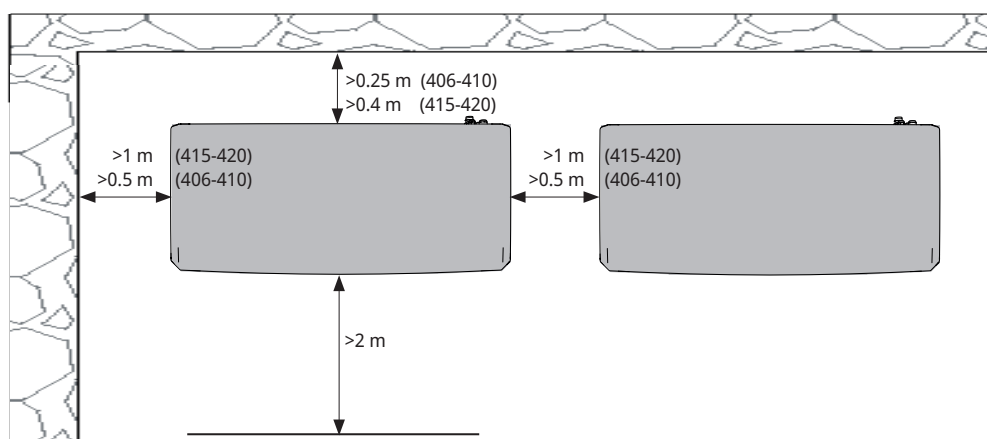


## 7.2 Preparation and drainage

The heat pump should be positioned so that the house cannot be damaged and the condensation water can easily drain into the ground. The base must be of concrete blocks or similar, resting on crushed stones or gravel.

- Make a 'stone curb' under the heat pump. Remember that there may be up to 70 litres of condensation water a day under some conditions.
- Dig a hole in the ground 70-100 cm deep.
- Place a moisture barrier in the hole on the side against the foundations of the building
- Half fill the hole with crushed stones and lay concrete blocks or similar.
- Measure out the correct \*c/c (centre to centre) measurement between the concrete blocks, so that the legs of the heat pump will fit in.


| *c/c-measurement  | CTC EcoAir 406-408 | CTC EcoAir 410-420 |
|-------------------|--------------------|--------------------|
| length (depth) mm | 1155 (451)         | 1285 (551)         |

- Use a spirit level to ensure that the blocks are level.
- Place crushed stones around the blocks in order to achieve optimal drainage.

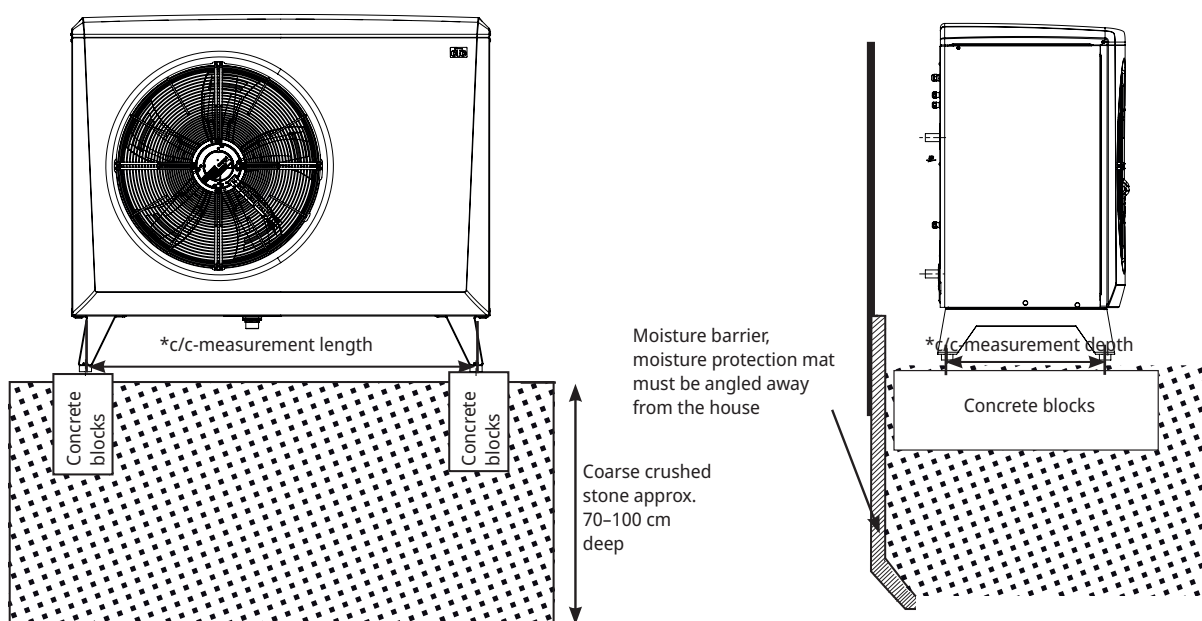

## 7.3 Condensation water

- The condensation tray is built into the heat pump and is used to divert most of the condensation water. The tray can be connected to a suitable drain. Connection diameter: 42 mm.
- A heating cable (available as an accessory) should be placed in the pipe to prevent refreezing. The heating cable is connected to the electrical cabinet of the heat pump (must be carried out by a qualified electrician and in accordance with applicable regulations).
- If the house has a cellar, it is advisable to route the condensation water to a floor drain indoors (to be performed according to the applicable rules). The pipe should be installed with a slope towards the house and above the ground (so no other water can get into the cellar). Wall apertures should be sealed and insulated. A water trap must be connected to the inside to prevent air from circulating in the pipe.
- If there is a stone curb, the outlet from the condensation water pipe should be placed at a frost-free depth.
- The condensation water can also be conducted to the building's drainage, e.g. downpipe drains. Here a heating cable must be placed in pipes that are **not** frost protected.

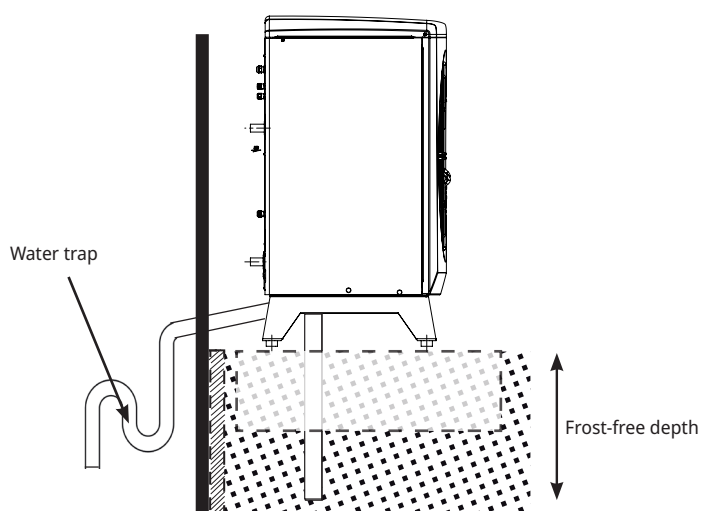



## 8. Pipe installation

The installation must be carried out in accordance with current MCS standards. Refer to MIS 3005 and associated building regs Part L,F & G. The boiler must be connected to an expansion vessel in an open or closed system. Do not forget to flush the heating circuit clean before connection.


**!** If necessary, flush the heating circuit clean before connection.

### 8.1 Pipe connection

- Return lines of at least 22 mm (for 406–410) and 28 mm (for 415–420) copper pipe are connected to the heat pump. For longer pipes, the installer should calculate the pump and pipe dimensions needed to handle the minimum recommended flow for the CTC EcoAir 400 concerned.
- Route the pipes between the heat pump and the boiler without any highest points. If this cannot be done, provide this highest point with an automatic air separator or an in line aerator.
- The connection to the heat pump should be made with a wire-reinforced diffusion-tight hose for DHW, min 1" diameter. Recommended hose length 1000 mm, to prevent noise transmission into the property and allow for movement of the heat pump.
- Pipes installed outside should be insulated\* with at least 13 mm thick, water-resistant pipe insulation. Ensure that the insulation is sealed tightly and comprehensively and that joints are thoroughly taped or glued.
- Indoor pipes should be insulated\* as far as the indoor unit with at least 9 mm thick insulation. This is to allow the heat pump to deliver the highest possible temperature to the indoor unit or tank without any losses.
- The product can be bled via the bleed valve inside the condenser.

**!** Minimum water volume (L) in the heating circuit (>25 °C) for reliable defrosting functionality:

|            |       |
|------------|-------|
| EcoAir 420 | 180 L |
| EcoAir 415 | 180 L |
| EcoAir 410 | 120 L |
| EcoAir 408 | 100 L |
| EcoAir 406 | 80 L  |

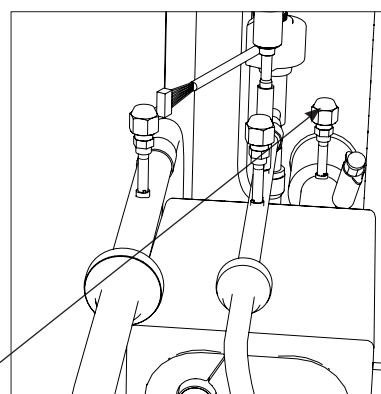


**!** NB: Only bleed this valve. Other valves are for the cooling system! If these are opened, refrigerant may leak out!

*\* Observe national and/or local regulations when dimensioning the thickness of pipe insulation.*

## 8.2 Example pipe connection

### EcoAir/EcoZenith i255 L

The CTC EcoZenith i255 L has pipes at the rear right edge for connection of the heat pump. The heat pump's lower connection is connected to the right connection when viewed from the front, so that water is pumped out to the heat pump. The heat pump's upper connection is thus connected to the right connection.

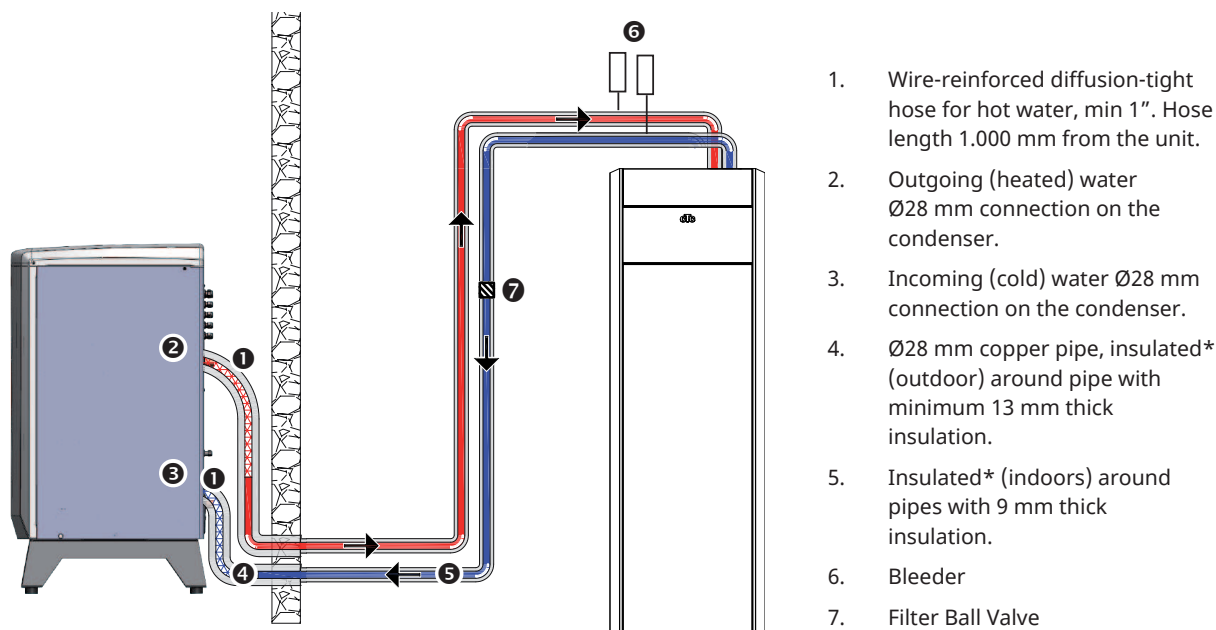

### EcoAir/EcoZenith i255 H

On the CTC EcoZenith i255 H, the heat pump is connected directly to the charge pump located under the tank. The heat pump's lower connection must be connected to the charge pump so that water is pumped out to the heat pump. The heat pump's upper connection is connected to the right 3-way valve by the charge pump.

## 8.3 Circulation pump

The choice of circulation pump depends on the type of system. Ensure that the circulation pump is large enough, so that there is sufficient flow through the heat pump. The circulation pump may be connected either internally within the CTC EcoAir 400 or externally in the controlling unit.

The charge pump supplies the CTC EcoAir 400 with water. If the outdoor temperature is below + 2°C the charge pump runs constantly to eliminate any risk of freezing.

### 8.3.1 Internal connection

With internal connection, the flow through the circulation pump is controlled by the controller in the CTC EcoAir 400. The control system for the CTC EcoAir 400 monitors and ensures that the unit is working within its operating range. For optimum performance, choose one of the A-class circulation pumps below.

|                    |                      |
|--------------------|----------------------|
| CTC EcoAir 406-408 | Prod. no. 587477 303 |
| CTC EcoAir 410     | Prod. no. 587477 302 |
| CTC EcoAir 415-420 | Prod. no. 587477 301 |

*\* Observe national and/or local regulations when dimensioning the thickness of pipe insulation.*

### 8.3.2 External connection

With external connection, a circulation pump is installed so that the right flow through the heat pump can be guaranteed. The flow is set at 50 RPS.

Set the right temperature differential by adjusting the speed of the circulation pump. This is to ensure that the right differential for the current outdoor temperature is produced according to the table.

| Outdoor temp. (°C) |                                    | -10 | -5    | 0      | +5     | +7   | +10   |
|--------------------|------------------------------------|-----|-------|--------|--------|------|-------|
| CTC EcoAir 406     | Primary flow 35 °C Flow = 0.21 l/s | 4°C | 4.5°C | 5.5 °C | 6.5 °C | 7 °C | 8°C   |
| CTC EcoAir 408     | Primary flow 35 °C Flow = 0.27 l/s | 4°C | 4.5°C | 5.5 °C | 6.5°C  | 7 °C | 7.5°C |
| CTC EcoAir 410     | Primary flow 35°C Flow = 0.39 l/s  | 4°C | 5°C   | 6°C    | 6.5°C  | 7°C  | 8°C   |
| CTC EcoAir 415     | Primary flow 35 °C Flow = 0.55 l/s | 4°C | 4.5°C | 5.5°C  | 6.5°C  | 7°C  | 7.5°C |
| CTC EcoAir 420     | Primary flow 35 °C Flow = 0.64 l/s | 4°C | 4.5°C | 5.5°C  | 6.5°C  | 7°C  | 7.5°C |

In some systems with EcoLogic, the entire radiator flow must go through the heat pump, so the pump must be sized according to the flow of the whole system. For safe operation, the following flow must be maintained:

CTC EcoAir 406: 760 l/hr                      CTC EcoAir 415: 2000 l/hr

CTC EcoAir 408: 960 l/hr                      CTC EcoAir 420: 2300 l/hr


CTC EcoAir 410: 1400 l/hr

This provides about: 7 °C temperature differential with an outside temperature of +7 °C and a primary flow temperature of 35 °C.

### 8.4 Pressure drop chart

The chart below shows the total water pressure drop for the heat pump.

Pressure drop (kPa)

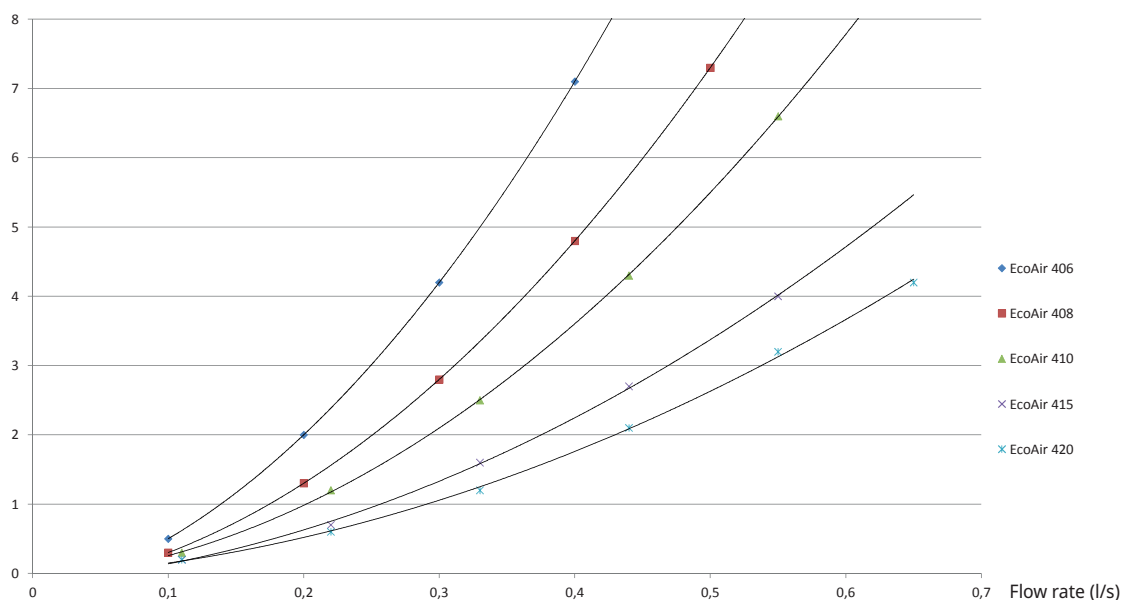

| Kvs value      |      |
|----------------|------|
| CTC EcoAir 406 | 5.1  |
| CTC EcoAir 408 | 6.5  |
| CTC EcoAir 410 | 7.5  |
| CTC EcoAir 415 | 9.8  |
| CTC EcoAir 420 | 11.4 |

| Kvs value                                      |      |
|--|------|
| Filter ball valve G1" (EcoAir 406/408)         | 11.1 |
| Filter ball valve G1 1/4" (EcoAir 410/415/420) | 19.8 |

## 8.5 Control/supply

### CTC EcoZenith i555 Pro

The circulation pump is controlled and powered by the CTC EcoZenith i550 Pro.

For more information, see the relevant product manual.

### CTC EcoZenith i255, CTC EcoZenith i360, CTC EcoVent i360F

The circulation pump is factory-fitted in CTC EcoZenith i255, CTC EcoZenith i360, CTC EcoVent i360F. Control and supply take place from the product. For more information, see the relevant product manual.

### CTC EcoLogic M/L

Up to 10 heat pumps can be connected to CTC EcoLogic M/L. The circulation pumps in heat pumps 1 and 2 can then be connected to CTC EcoLogic M/L. The circulation pumps for heat pumps 3–10 should be connected to the CTC EcoAir 400.

### CTC EcoLogic v3

The circulation pump (not speed-controlled) must be connected to the CTC EcoAir 400.

### CTC EcoZenith v3


The circulation pump (not speed-controlled) must be connected to the CTC EcoAir 400.

### CTC EcoEI v3

The circulation pump (not speed-controlled) must be connected to the CTC EcoAir 400.

## 8.6 Operating range

The control system for the CTC EcoAir 400 monitors and ensures that the unit is working within its operating range.

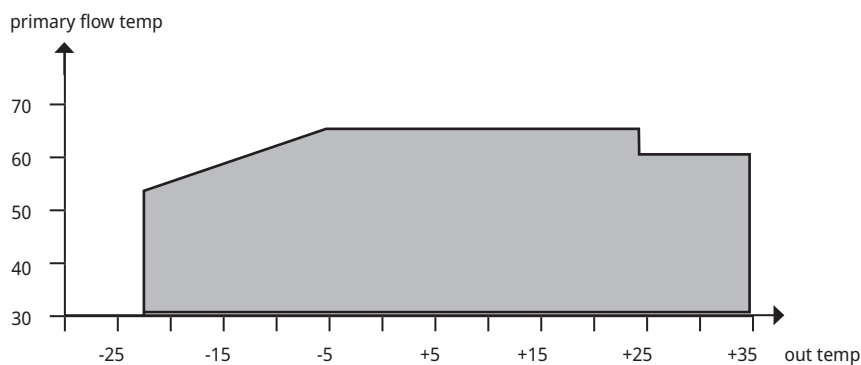

## 9. Electrical installation

### 9.1 General information, electrical connections



Installation and heat pump connection must be performed by an authorised electrician. All wiring must be installed according to applicable provisions. Before the front panel is opened or other live components are made accessible, the power supply to the heat pump must be fully disconnected.

### 9.2 Electric installation 400V 3N~

#### Supply, black connector

CTC EcoAir 400 must be connected to 400V 3N~ 50Hz and protective earth. The minimum group fuse size is specified in "Technical data". The 2 m long power supply cable is pre-connected to the product.

#### Safety switch

The installation should be preceded by an omnipolar safety switch which ensures disconnection from all electric power sources.

### 9.3 Electrical installation 230V 1N~

#### Supply, black connector


CTC EcoAir 400 must be connected to 230V 1N~ 50Hz and protective earth. The minimum group fuse size is specified in "Technical data". The 2 m long power supply cable is pre-connected to the product.

#### Omnipolar safety switch

The installation should be preceded by an omnipolar safety switch according to overvoltage category III, which ensures disconnection from all electric power sources.

### 9.4 Alarm output


The CTC EcoAir 400 is fitted with a potential-free alarm output which is activated if any alarm is active in the heat pump. This output may be connected to a maximum load of 1A 250V AC. An external fuse should also be used. A cable approved for 230V AC must be used for connecting this output, irrespective of the load that is connected. For connection information, see the wiring diagram.



Close-up from wiring diagram.

### 9.5 Heat pump connections

Ensure that the heat pump dip switch 2 is in the "ON" position (Factory setting).

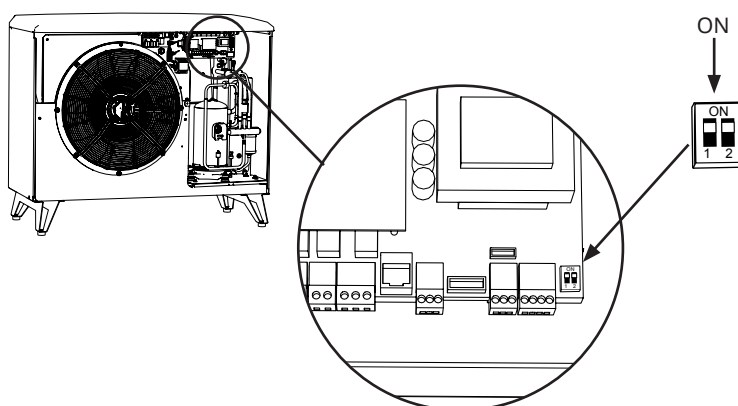




## 9.6 Series connection of the CTC EcoAir 400

### 9.6.1 Series connected heat pump connections


In a series connection, dip switch 2 must be set to the "OFF" position on all heat pumps except the last one, which should be set to "ON".

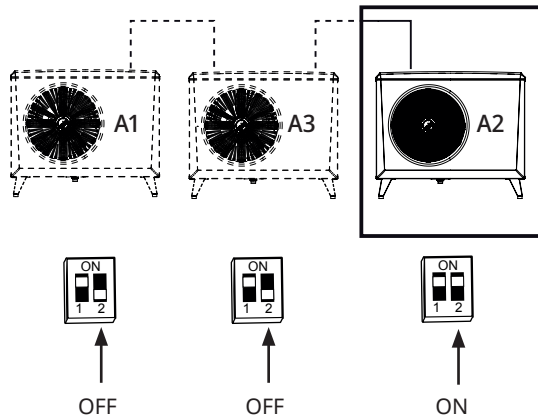



**!** The last heat pump connected in series must be set to the ON position.

### 9.6.2 Connecting the CTC Basic Display

Connecting the CTC Basic Display (accessory)

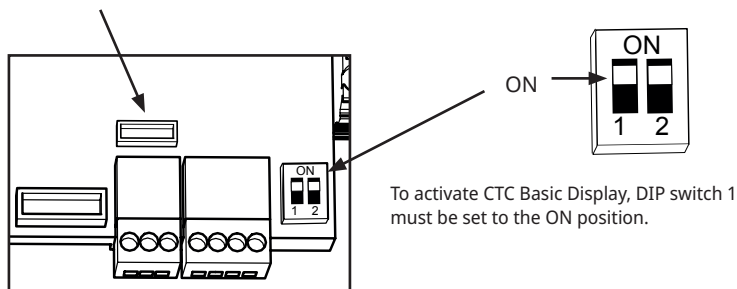

## Heat pumps in series connection

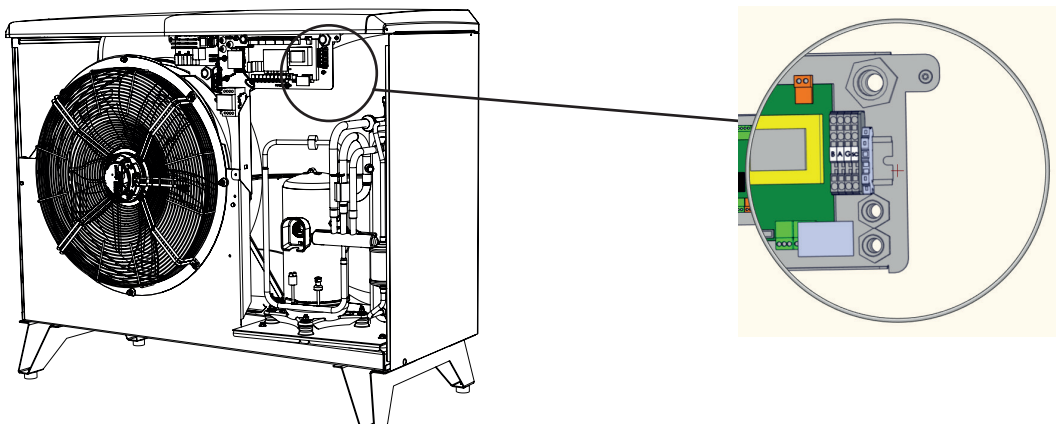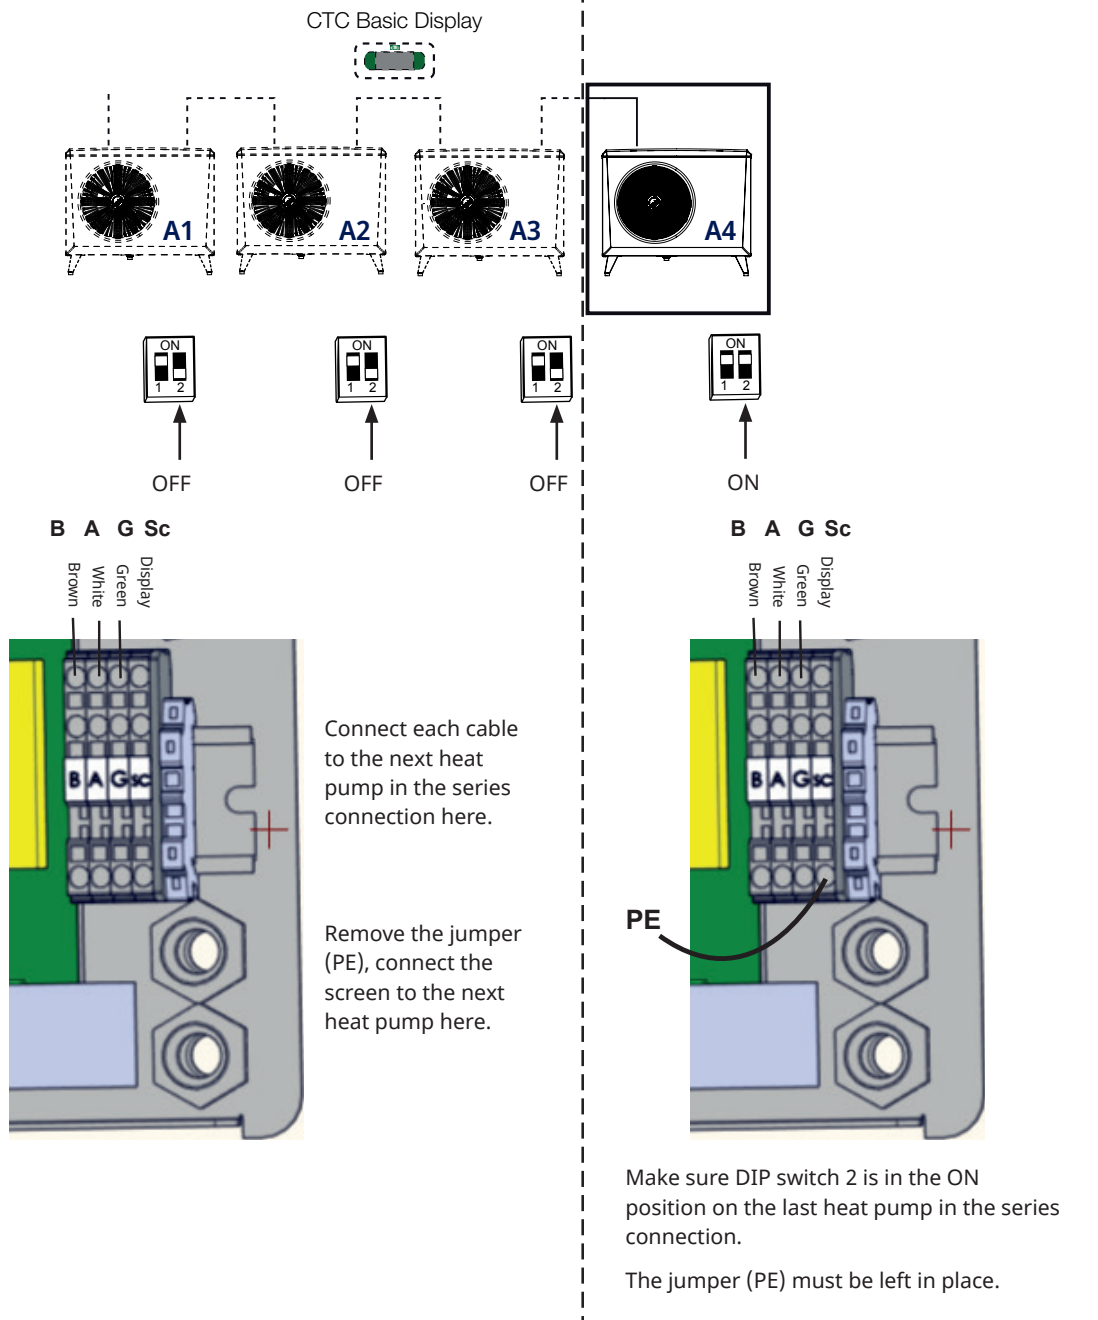


## 9.7 Connecting the control system

### 9.7.1 Define number of heat pumps

Define the heat pumps in the controlling product's display under: "Advanced/Defin/Heat pump".


Set the heat pumps contained in the system to position "On".

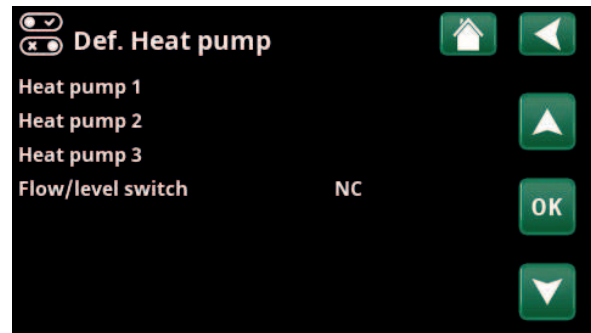

Example of a system with 3 heat pumps.


### 9.7.2 Numbering CTC EcoAir to HP2

Applies to control launched in October 2020 with three connectors on the back of the display. 2 RJ-45 and 1 RJ-12.

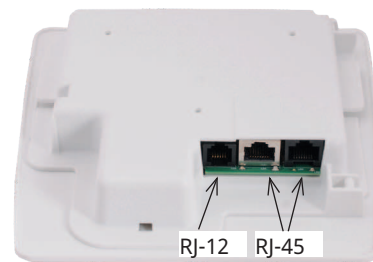

1. System disconnected from power.

2. Energise the control (EcoLogic or EcoZenith i555 Pro) as well as the CTC EcoAir which will be numbered as Heat Pump 2 (HP2).

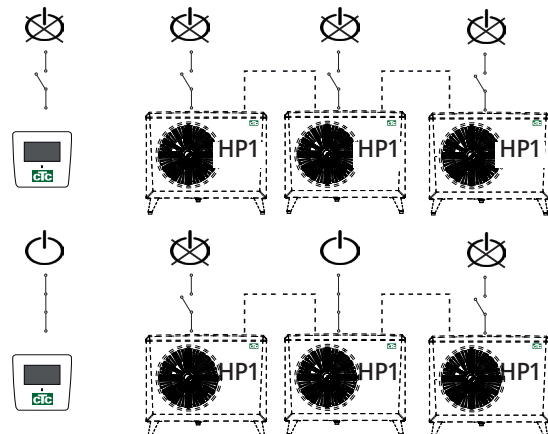


3. Wait for about 2 minutes.

4. Go to "Installer/Service/Set Address".

Select "Current address", press OK and press the down arrow until the current heat pump appears (HP1) Press OK.



Select "New address", press OK and use the arrow to scroll up and down until the address of the current heat pump address is shown (HP2). Press OK.

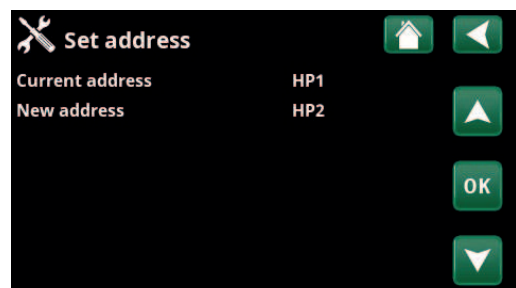

5. The heat pump is now numbered (HP2).

When you press OK, (HP1 and HP2)\* disappears and the row "Current address/New address" will go dark.

*\*In this example, we have assumed that the heat pump is called HP1, which is the factory default. If the heat pump has already been renumbered, then select this number instead.*

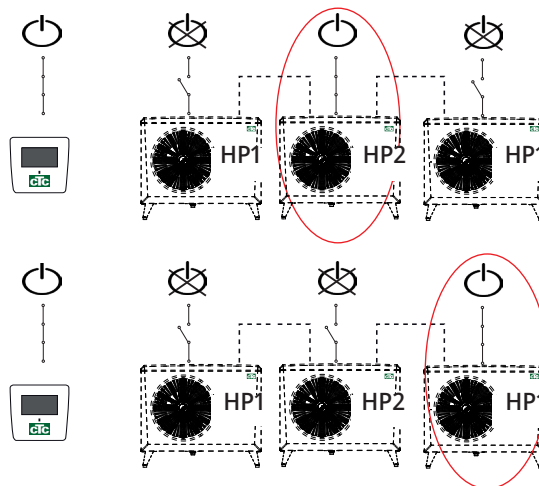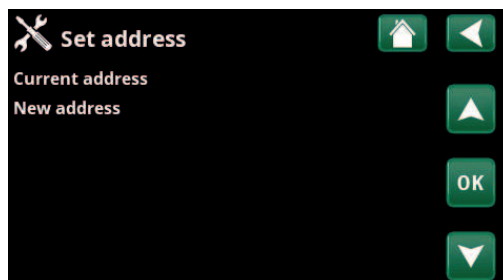

6. Number the other heat pumps:


Energise the next heat pump, which will be numbered heat pump 3 (HP3).

7. Wait 2 minutes.

8. Go to "Service/Set Address".

Select "Current address", press OK and press the down arrow until the current heat pump appears (HP1) Press OK.


Select "New address", press OK and press the up arrow until the current heat pump address appears (HP3). Press OK.

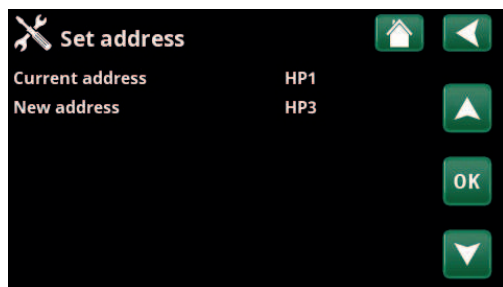

9. The heat pump is now numbered (HP3).

When you press OK, (HP1 and HP3)\* disappears and the row "Current address/New address" will go dark.

*\*In this example, we have assumed that the heat pump is called HP1, which is the factory default. If the heat pump has already been renumbered, then select this number instead.*

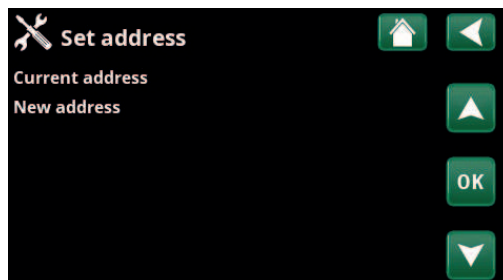


10. Redo the procedure according to the number of heat pumps to be numbered.

When all heat pumps are numbered and energised, they should be displayed when you press the heat pump symbol in the menu "Operation data". If any heat pump does not appear in the menu (communication with the heat pump fails) It may be because it has not been numbered as described above.

If you do not know the name of the heat pump, you can reset the numbering by using the "Select/Rename Heat Pump" menu (refer to points 9 and 10 above) to indicate all possible names of the heat pump, i.e. you select and confirm HP1 and then HP2 up to HP10 to ensure that the correct name is given.

Finally test in the menu "Installer/Service/Function test/Heat pump" that the respective heat pump starts.

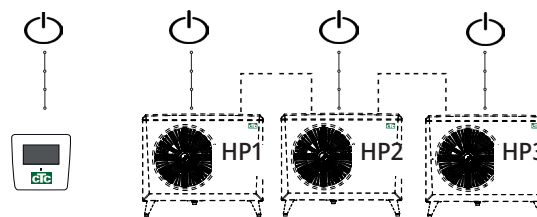



### 9.7.3 Worth knowing when addressing

#### Error set Address

- The heat pump could not be found and numbered.
- The heat pump was not what it was supposed to be called.
- No communication with the heat pump.
- Check that the heat pump is energised.

If the setting of the address fails, the latest heat pump addresses remain. In this example HP1 and HP2.


- Make sure the heat pump is energised.
- Try again with a new current address.

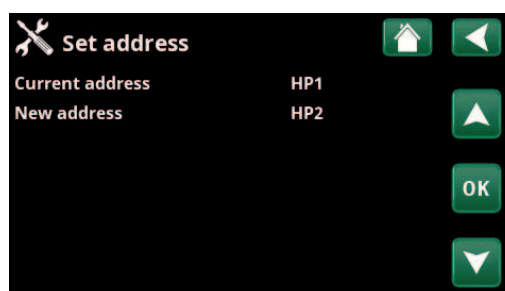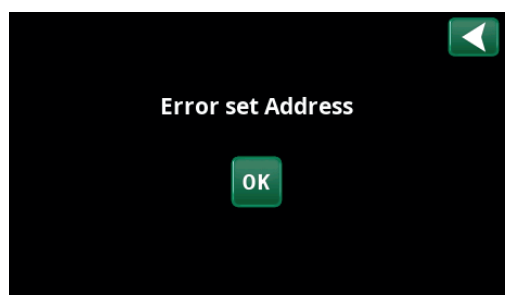


### 9.7.4 Numbering CTC EcoAir as A2

Applies to older controls with 2 connectors on the back of the display.


1 RJ-45 and 1 RJ-12 for the CTC EcoZenith i550 Pro and CTC EcoLogic Pro/Family.

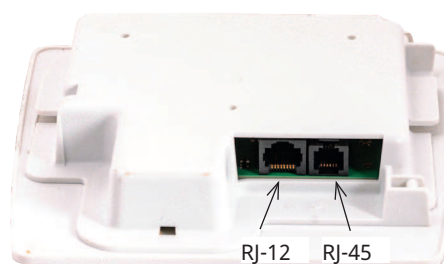


1. System disconnected from power.

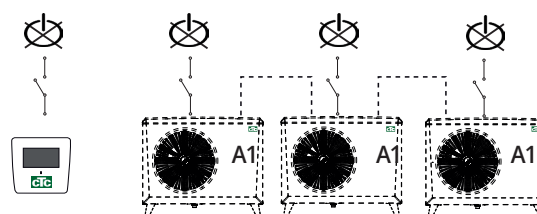


2. Energise the control (EcoLogic Pro or EcoZenith i550 Pro) as well as the CTC EcoAir which will be numbered as Heat Pump 2 (HP2).

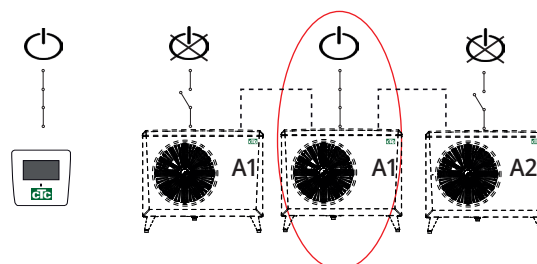

3. Wait approx 2 minutes until the heat pump is visible in the "Operation data" menu.

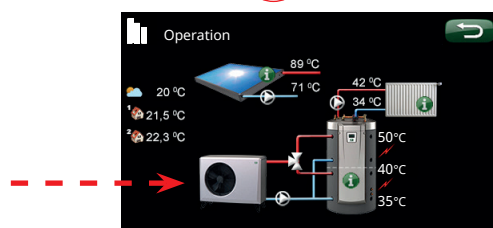


4. Go to Installer/Settings/Heat pump 2 and the row "Select/Rename Heat pump". Press OK.

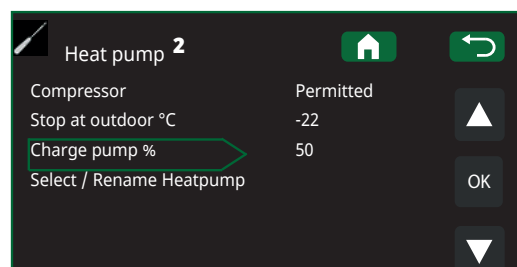


5. Press the arrow up until (A1)\* is displayed. Press OK.

After pressing OK, (A1)\* disappears and the "Select/Rename Heat Pump" row darkens.

*\*In this example, we have assumed that the heat pump is called A1, which is the factory default. If the heat pump has already been renumbered, then select this number instead.*

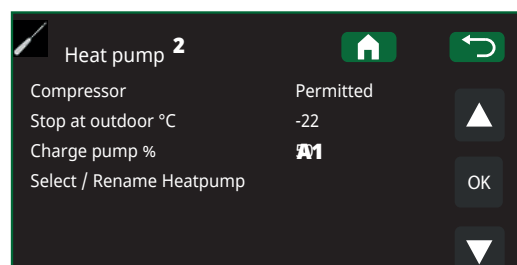


6. The heat pump is now numbered (A2).

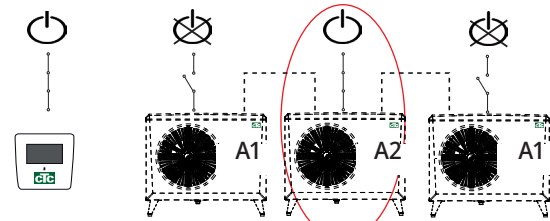


7. To number the other heat pumps:


Energise the control and the next heat pump to be numbered to heat pump 3 (A3).

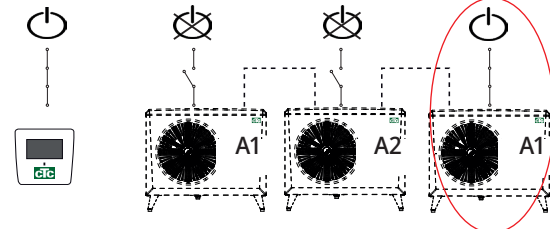

8. Wait approx 2 minutes until the heat pump is visible in the operational information.

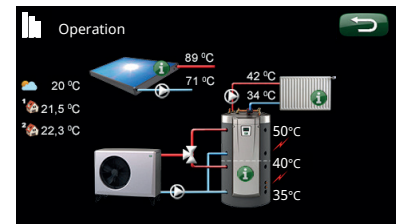


9. Go to Installer/Settings/Heat pump 3 and the row "Select/Rename Heat pump". Press OK.

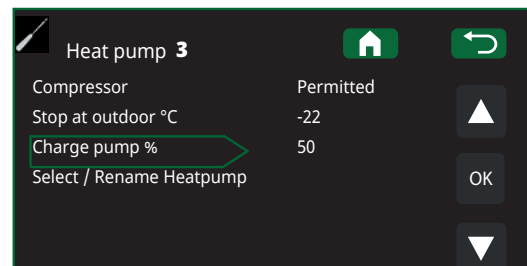

10. Press the arrow up until (A1)\* is displayed. Press OK.

After pressing OK, (A1)\* disappears and the "Select/Rename Heat Pump" row darkens. The heat pump is now numbered (A3).

*\*In this example, we have assumed that the heat pump is called A1, which is the factory default. If the heat pump has already been renumbered, then select this number instead.*

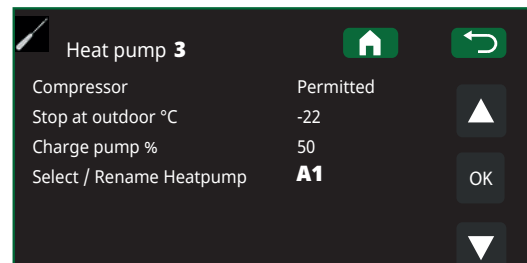


11. Redo the procedure according to the number of heat pumps to be numbered.

When all heat pumps are numbered and energised, they should be displayed when you press the heat pump symbol in the menu "Operation data". If any heat pump does not appear in the menu (communication with the heat pump fails) It may be because it has not been numbered as described above.

If you do not know the name of the heat pump, you can reset the numbering by using the "Select/Rename Heat Pump" menu (refer to points 9 and 10 above) to indicate all possible names of the heat pump, i.e. you select and confirm A1 and then A2 up to A10 to ensure that the correct name is given.

Finally test in the menu "Advanced/Service/Function test/Heat pump" that the respective heat pump starts.

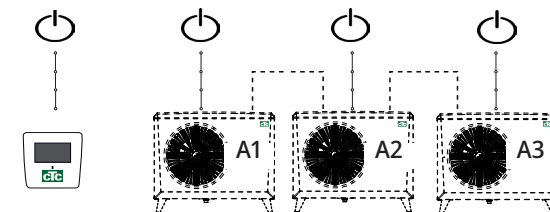



## 9.8 Connecting the control system

### 9.8.1 General

When connecting the CTC EcoAir 400 to products with different control systems, accessories are sometimes needed to control the products. The various alternatives available are described in this section.

### 9.8.2 Connection option 1 one heat pump


When connecting CTC EcoAir 400 to CTC EcoZenith i255, CTC EcoZenith i555 Pro, CTC EcoZenith i360, CTC EcoVent i360F and CTC EcoLogic M/L, the communication cable (LiYCY (TP)) must be connected directly to the respective products.

### 9.8.3 Connection option 2 multiple heat pumps

#### CTC EcoLogic M/L or CTC EcoZenith i555 Pro

When connecting more than one heat pump to CTC EcoLogic M/L or CTC EcoZenith i555 Pro, the CTC Basic Display accessory can be used to address the various heat pumps A1, A2, A3, and so on. All CTC EcoAir 400 units are factory-set addressed to A1. For connection, refer to the CTC Basic Display manual. Recommended cable between products LiYCY (TP).

**!** When connected in series, the last heat pump must be set to terminated position.

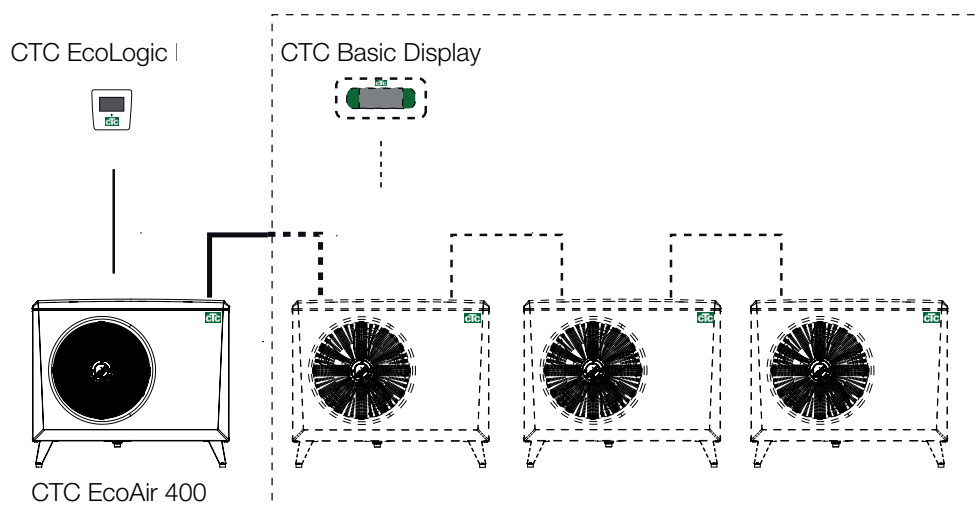


### 9.8.4 Connection option 3

#### CTC EcoEl v3

Because these products have an older control system of v3 type, the CTC Converter accessory must be used as an interpreter to control the CTC EcoAir 400. See the manual for the CTC Converter for connecting this.

**!** Version 3 (V3) relates to models manufactured from 2006 onwards.

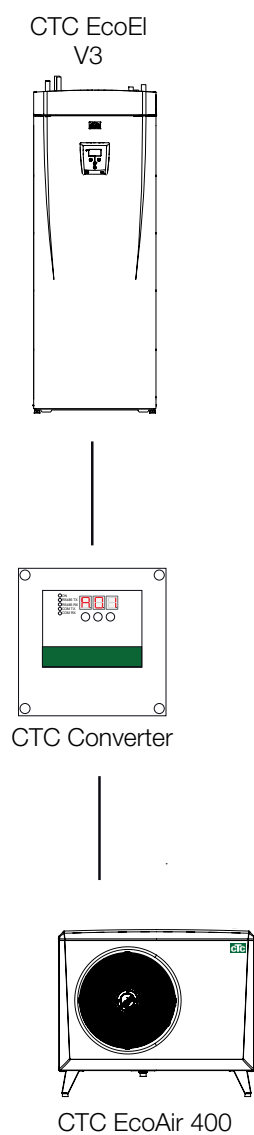

## 9.8.5 Connection option 4

### CTC EcoZenith v3 or CTC EcoLogic v3

Because these products have an older control system of v3 type, the CTC Converter accessory must be used as an interpreter to control the CTC EcoAir 400. See the manual for the CTC Converter for connecting this.


The CTC EcoZenith version 3 is available in two different variants. An earlier variant with only one communication port, and a later one with three such ports. The earlier one will have a serial number starting from:

| Serial no.     | Item no.  | Model                      |
|----------------|-----------|----------------------------|
| 7250-1222-0138 | 583700001 | CTC EcoZenith I 550 3x400V |
| 7250-1222-0168 | 584892001 | CTC EcoZenith I 550 3x230V |
| 7250-1222-0171 | 584890001 | CTC EcoZenith I 550 BBR    |
| 7250-1222-0171 | 584893001 | CTC EcoZenith I 550 1x230V |

The earlier version needed a Converter to control the heat pump.

**!** Version 3 (V3) relates to models manufactured from 2006 onwards.

**!** If new (version 4) and old (version 3) heat pumps are combined in an installation, the new ones must be addressed A1.

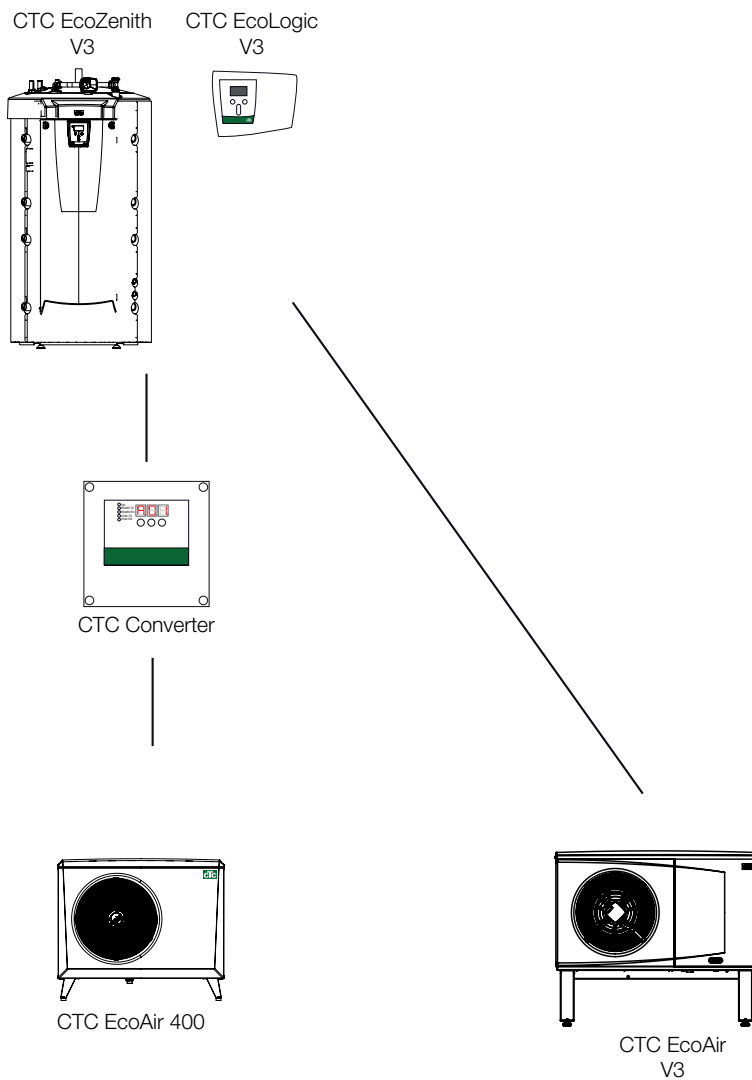

**!** When connected in series, the last CTC EcoAir 400 must be set to the terminated position.

### 9.8.6 Connection option 5


#### CTC EcoZenith I 550

The CTC EcoZenith version 3 is available in two different variants. An earlier variant with only one communication port, and a later one with three such ports. The later one will have a serial number starting from:


| Serial no.     | Item no.  | Model                      |
|----------------|-----------|----------------------------|
| 7250-1222-0139 | 583700001 | CTC EcoZenith I 550 3x400V |
| 7250-1222-0169 | 584892001 | CTC EcoZenith I 550 3x230V |
| 7250-1222-0172 | 584890001 | CTC EcoZenith I 550 BBR    |
| 7250-1222-0172 | 584893001 | CTC EcoZenith I 550 1x230V |

For the later variant a CTC Converter is needed for each version 4 heat pump.

See the manual for the CTC Converter for connection.

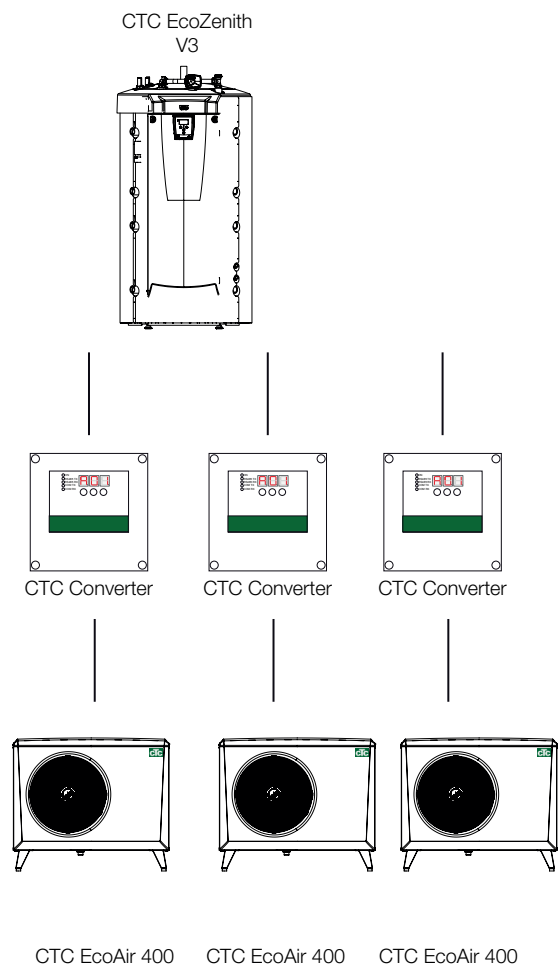

## 9.9 Wiring diagram 400V 3N~

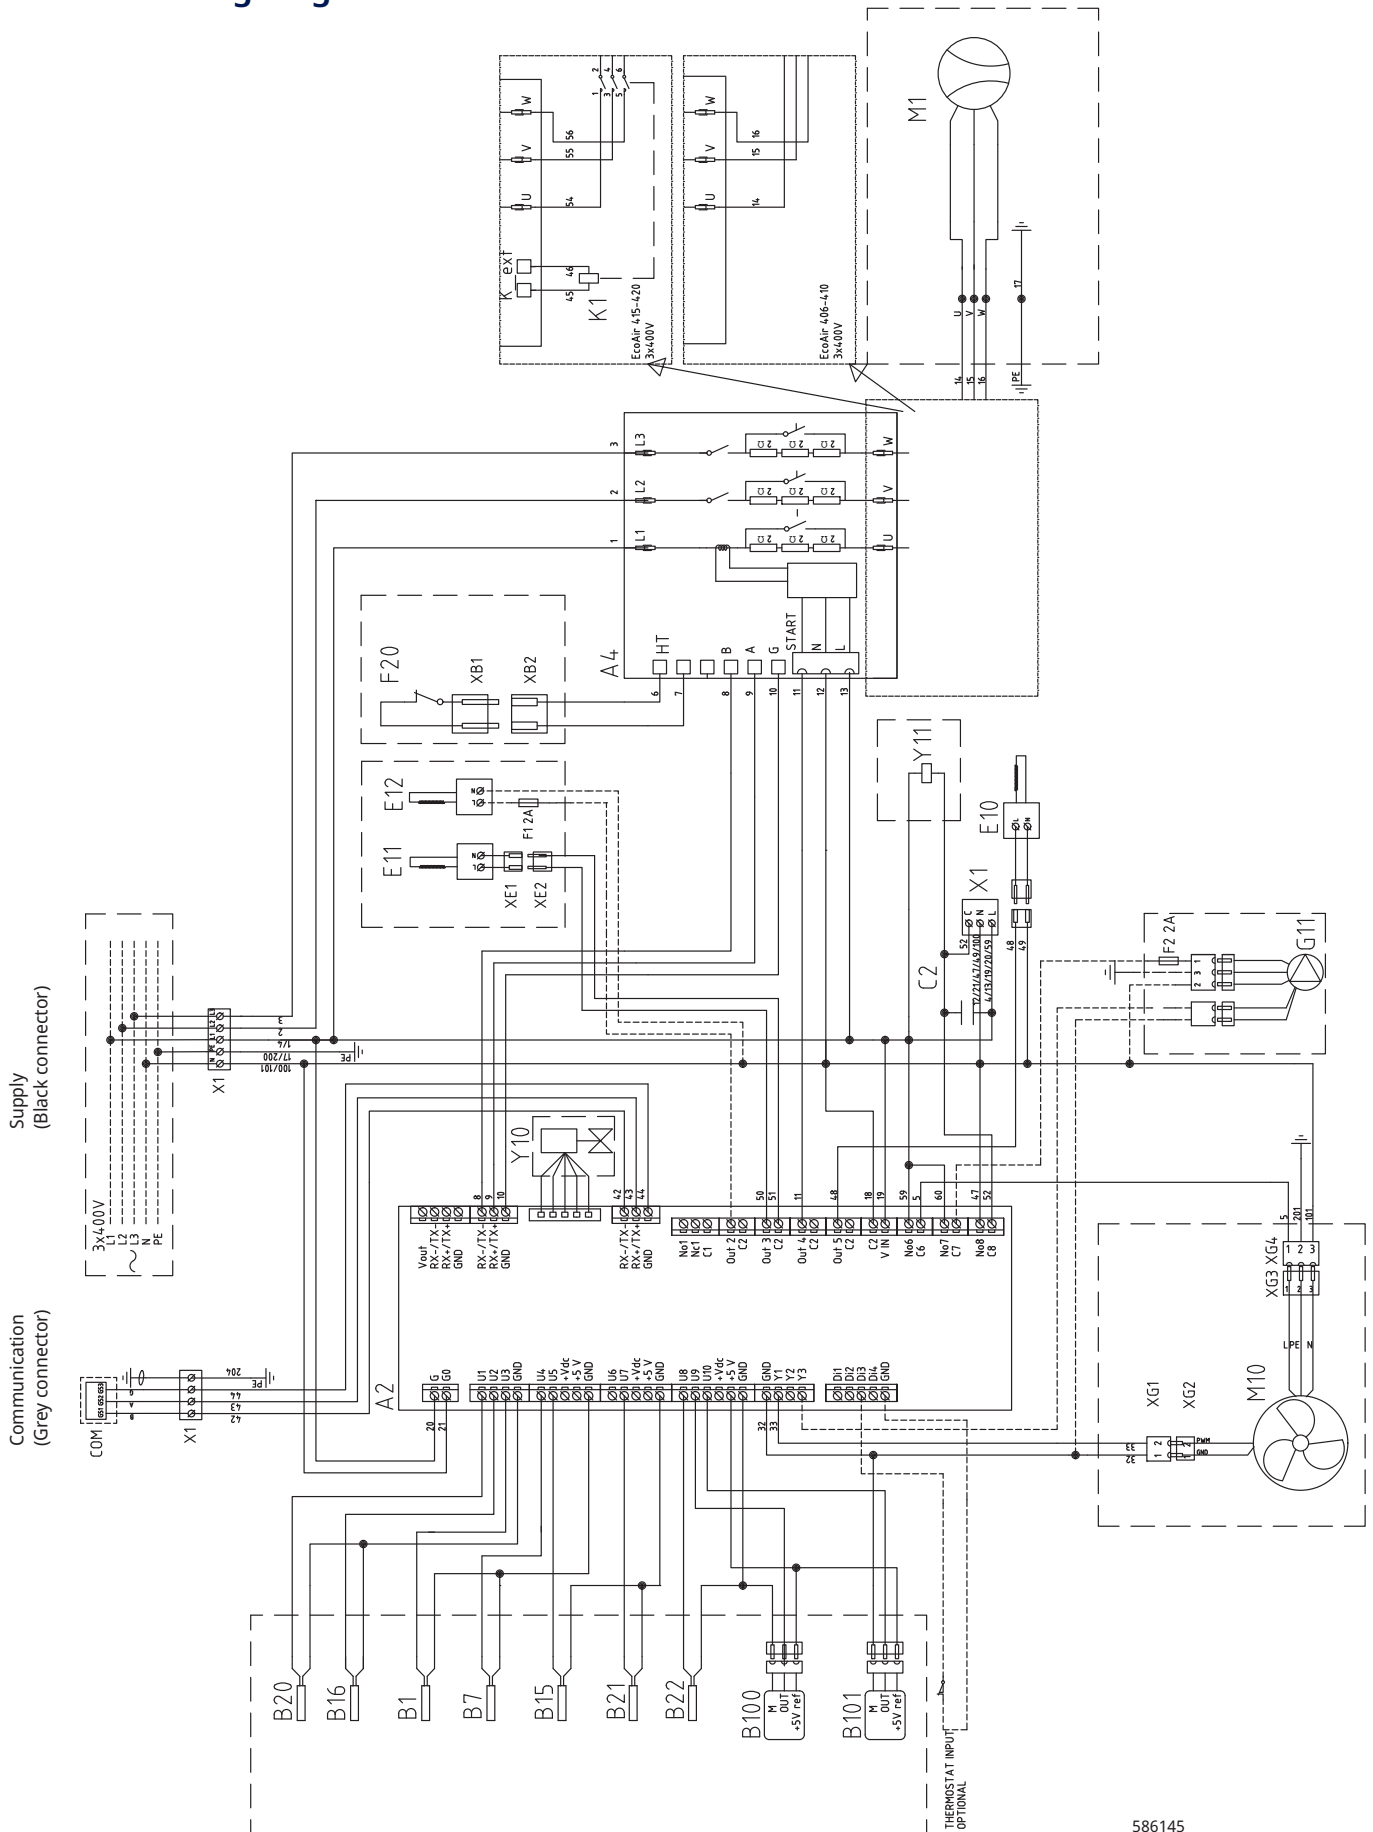



## 9.11 Parts list

|      |  |                    |
|------|--|--------------------|
| A2   | Relay/main card  |                    |
| A4   | Soft-start card with motor protection and contactor function |                    |
| B1   | Primary flow sensor  | Type 2 NTC/NTC 22  |
| B7   | Return sensor  | Type 2 NTC/NTC 22  |
| B15  | Outdoor sensor   | Type 1 NTC/NTC 22  |
| B16  | Defrosting sensor  | Type 1 NTC/NTC 22  |
| B20  | Fan sensor   | Type 1 NTC/NTC 22  |
| B21  | Discharge sensor   | Type 3 NTC/NTC 50  |
| B22  | Suction gas sensor   | Type 1 NTC/NTC 015 |
| B100 | High pressure sensor   |                    |
| B101 | Low pressure sensor  |                    |
| C1   | Condenser compressor (1-phase)                               |                    |
| C2   | Condenser  |                    |
| E10  | Compressor heater  |                    |
| E11  | Condenser tray heater  |                    |
| E12  | Heating cable (option)                                       |                    |
| F1   | Fuse (option)  |                    |
| F20  | High pressure switch   |                    |
| G11  | Charge pump (option)   |                    |
| K1   | Contactor (EA415-420)  |                    |
| M1   | Compressor   |                    |
| M10  | Fan  |                    |
| X1   | Terminal block   |                    |
| XM1  | Connector supply Male  |                    |
| XM2  | Connector supply Female                                      |                    |
| XC1  | Connector compressor Male                                    |                    |
| XC2  | Connector compressor Female                                  |                    |
| Y10  | Expansion valve  |                    |
| Y11  | Solenoid valve   |                    |

## 9.12 Sensor Data

| Temperature °C | Sensor Type 1 NTC<br>Resistance kΩ | Temperature °C | Sensor Type 2 NTC<br>Resistance kΩ | Temperature °C | Sensor Type 3 NTC<br>Resistance kΩ |
|----------------|------------------------------------|----------------|------------------------------------|----------------|------------------------------------|
| 100            | 0.22                               | 100            | 0.67                               | 130            | 5.37                               |
| 95             | 0.25                               | 95             | 0.78                               | 125            | 6.18                               |
| 90             | 0.28                               | 90             | 0.908                              | 120            | 7.13                               |
| 85             | 0.32                               | 85             | 1.06                               | 115            | 8.26                               |
| 80             | 0.37                               | 80             | 1.25                               | 110            | 9.59                               |
| 75             | 0.42                               | 75             | 1.47                               | 105            | 11.17                              |
| 70             | 0.49                               | 70             | 1.74                               | 100            | 13.06                              |
| 65             | 0.57                               | 65             | 2.07                               | 95             | 15.33                              |
| 60             | 0.7                                | 60             | 2.5                                | 90             | 18.1                               |
| 55             | 0.8                                | 55             | 3.0                                | 85             | 21.4                               |
| 50             | 0.9                                | 50             | 3.6                                | 80             | 25.4                               |
| 45             | 1.1                                | 45             | 4.4                                | 75             | 30.3                               |
| 40             | 1.3                                | 40             | 5.3                                | 70             | 36.3                               |
| 35             | 1.5                                | 35             | 6.5                                | 65             | 43.6                               |
| 30             | 1.8                                | 30             | 8.1                                | 60             | 52.8                               |
| 25             | 2.2                                | 25             | 10                                 | 55             | 64.1                               |
| 20             | 2.6                                | 20             | 12.5                               | 50             | 78.3                               |
| 15             | 3.2                                | 15             | 15.8                               | 45             | 96.1                               |
| 10             | 4                                  | 10             | 20                                 | 40             | 119                                |
| 5              | 5                                  | 5              | 26                                 | 35             | 147                                |
| 0              | 6                                  | 0              | 33                                 | 30             | 184                                |
| -5             | 7                                  | -5             | 43                                 | 25             | 232                                |
| -10            | 9                                  | -10            | 56                                 | 20             | 293                                |
| -15            | 12                                 | -15            | 74                                 | 15             | 373                                |
| -20            | 15                                 | -20            | 99                                 | 10             | 479                                |
| -25            | 19                                 | -25            | 134                                | 5              | 619                                |
| -30            | 25                                 | -30            | 183                                |                |                                    |



| Temperature °C | NTC 50<br>Resistance kΩ | Temperature °C | NTC 22 k<br>Resistance Ω | Temperature °C | NTC 015<br>Resistance Ω |
|----------------|-------------------------|----------------|--------------------------|----------------|-------------------------|
| 150            | 0.89                    | 130            | 800                      | 40             | 5830                    |
| 145            | 1.00                    | 125            | 906                      | 35             | 6940                    |
| 140            | 1.14                    | 120            | 1027                     | 30             | 8310                    |
| 135            | 1.29                    | 115            | 1167                     | 25             | 10000                   |
| 130            | 1.47                    | 110            | 1330                     | 20             | 12090                   |
| 125            | 1.67                    | 105            | 1522                     | 15             | 14690                   |
| 120            | 1.91                    | 100            | 1746                     | 10             | 17960                   |
| 115            | 2.19                    | 95             | 2010                     | 5              | 22050                   |
| 110            | 2.5                     | 90             | 2320                     | 0              | 27280                   |
| 105            | 2.9                     | 85             | 2690                     | -5             | 33900                   |
| 100            | 3.4                     | 80             | 3130                     | -10            | 42470                   |
| 95             | 3.9                     | 75             | 3650                     | -15            | 53410                   |
| 90             | 4.6                     | 70             | 4280                     | -20            | 67770                   |
| 85             | 5.4                     | 65             | 5045                     | -25            | 86430                   |
| 80             | 6.3                     | 60             | 5960                     |                |                         |
| 75             | 7.4                     | 55             | 7080                     |                |                         |
| 70             | 8.8                     | 50             | 8450                     |                |                         |
| 65             | 10.4                    | 45             | 10130                    |                |                         |
| 60             | 12.5                    | 40             | 12200                    |                |                         |
| 55             | 15                      | 35             | 14770                    |                |                         |
| 50             | 18                      | 30             | 18000                    |                |                         |
| 45             | 22                      | 25             | 22000                    |                |                         |
| 40             | 27                      | 20             | 27100                    |                |                         |
| 35             | 33                      | 15             | 33540                    |                |                         |
| 30             | 40                      | 10             | 41800                    |                |                         |
| 25             | 50                      | 5              | 52400                    |                |                         |
| 20             | 62                      | 0              | 66200                    |                |                         |
| 15             | 78                      | -5             | 84750                    |                |                         |
| 10             | 99                      | -10            | 108000                   |                |                         |
| 5              | 126                     | -15            | 139000                   |                |                         |
|                |                         | -20            | 181000                   |                |                         |
|                |                         | -25            | 238000                   |                |                         |

## 10. First start

1. Check that the boiler and system are full of water and have been bled.
2. Check that all connections are tight.
3. Check that sensors and the charge pump are connected to the power source.
4. Energise the heat pump by switching on the operating switch (the main switch).

Once the system has heated up, check that all connections are tight, the various systems have been bled, heat is coming out into the system and warm water is coming out at the tap locations.

## 11. Operation and Maintenance

When the installer has installed your new heat pump, you should check along with the installer that the system is in perfect operating condition. Let the installer show you where the power switches, controls and fuses are so that you know how the system works and how it should be maintained. Bleed the radiators (depending on type of system) after around three days of operation and top up with water if required.

### 11.1 Defrost

The CTC EcoAir 400 is fitted with discharge defrosting. The heat pump checks constantly whether defrosting is needed and, if so, defrosting starts, the fan stops, the 4-way valve changes direction and the discharge goes to the evaporator instead. A hissing sound is heard as the water drains from the evaporator. When the product has defrosted, the fan starts and the discharge goes into the condenser instead, and the heat pump returns to normal operation.

### 11.2 The fan

The fan starts 15 seconds before the condenser and runs until the compressor stops. During defrosting the fan stops and restarts when defrosting is finished.

### 11.3 Maintenance

A large amount of water passes through the evaporator in the CTC EcoAir 400. Leaves and other debris can get stuck and restrict the air flow. At least once year the evaporator coil should be checked and cleared of particles that block the air flow. The evaporator and outer covering should be cleaned with a damp cloth or soft brush. No other periodic maintenance or inspection is necessary.

### 11.4 Periodic maintenance

After three weeks of operation and every three months of the first year, thereafter once a year:

- Check that the installation is free of leaks.
- Check that the product and system are free of air; bleed if needed.
- Check that the evaporator is clean.
- The products **do not** require annual inspection for refrigerant leakage

### 11.5 Operation stop

The heat pump is shut down using the operating switch. If there is a risk of the water freezing, ensure that there is circulation through the heat pump or drain out all the water from the CTC EcoAir 400.

### 11.6 Condensation water tray

The condensation tray collects water formed on the CTC EcoAir evaporator during operation and defrosting. The condensation water tray is equipped with an electric heating coil which keeps the tray free of ice when the outside temperature is below freezing. The condensation tray is located at the bottom on the back of CTC EcoAir 400. By lifting the handle and pulling it out, you can clean and inspect the condensation tray. You can buy a heating cable as an accessory and connect it to the EcoAir 400. The cable must be installed in the drain from the condensation tray to a frost-free drain.

## 12. Troubleshooting

The CTC EcoAir is designed to provide reliable operation and high levels of comfort, and to have a long service life. Various tips are given below which may be helpful and guide you in the event of an operational malfunction.

If a fault occurs, you should always contact the installer who installed your unit. If the installer believes the malfunction is due to a materials or design fault, then they will contact us to check and rectify the issue. Always provide the product's serial number.

### Air problems

If you hear a rasping sound from the heat pump, check that it is properly bled. Top up with water where required, so that the correct pressure is achieved. If this noise recurs, call a technician to check the cause.

### Alarm

Any alarms and information texts from the CTC EcoAir are displayed in the product which is used to control it; you should therefore consult the manual for that product.

### Circulation and defrosting

If the circulation between the indoor and the outdoor unit is reduced or stops, the high pressure switch is triggered.

Possible reasons for this:

- circulating pump defective or too small.
- air in the pipes.
- condenser clogged.
- other intermediate obstructions to the water flow.

During defrosting the fan stops but the compressor operates and the melted snow and ice flows into the condensation tray under the heat pump. When defrosting stops, the fan starts again and initially a vapour cloud, consisting of damp air which condenses in the cold outdoor air, is created. This is perfectly normal and stops after a few seconds. If the pump heats poorly, check that no unusual ice formation has occurred.

Possible reasons for this:

- defective defrosting automation.
- Lack of refrigerant (leakage).
- Extreme weather conditions.

Remember that CTC EcoAir is an air source heat pump that produces less heating when outdoor temperatures fall, while the heating needs of the house increase. When temperatures fall quickly, this means that you may experience a lack of heating power.













CTC AB Box 309 SE-341 26 Ljungby  
info@ctc.se +46 372 88 000  
www.ctc.se